

Job Name/Location:

Tag #:

Date:	For: File	Resubmit
PO No.:	Approval	Other_____
Architect:	GC:	
Engr:	Mech:	
Rep:	(Project Manager)	
(Company)		



## LV361HV

### Single Zone Vertical Air Handling Unit

Outdoor Unit (ODU) - LUU360HV Indoor Unit (IDU) - LVN361HV4

#### Performance:

##### Cooling:

Cooling Capacity (Min~Rated~Max, Btu/h)	14,400 ~ 33,200 ~ 39,000
SEER2 / EER2	16.30 / 11.90

SEER - Seasonal Energy Efficiency Ratio

EER - Energy Efficiency Ratio

##### Heating:

Heating Capacity (Min~Rated~Max, Btu/h)	16,000 ~ 40,000 ~ 43,000
HSPF2	8.95
Max heating @ Indoor 70° DB (Btu/h)	
Outdoor 17°F WB	37,350
Outdoor 5°F WB	33,800
Outdoor -4°F WB	32,220

HSPF - Heating Seasonal Performance Factor  
Cooling Nominal Test Conditions:  
Indoor: 80°F DB / 67°F WB  
Outdoor: 95°F DB / 75°F WB

Heating Nominal Test Conditions:  
Indoor: 70°F DB / 60°F WB  
Outdoor: 47°F DB / 43°F WB

#### Electrical:

Power Supply <sup>1</sup> (V/Hz/Ø)	208-230 / 60 / 1
MOP / MCA (A)	40 / 32
Cooling / Heating Rated Amps (A)	26.3 / 26.3
Compressor(A)	22.0
Fan Motor (IDU + ODU) (A)	1.1 + (1.6 x 2)
Cooling Power Input (Min~Rated~Max, kW)	1.00 ~ 3.27 ~ 3.60
Heating Power Input (Min~Rated~Max, kW)	1.02 ~ 3.65 ~ 4.48

MOP - Maximum Overcurrent Protection

MCA - Minimum Circuit Ampacity

#### Piping:

Installed Liquid Pipe (in., O.D.)	3/8 Flare
Installed Vapor Pipe (in., O.D.)	5/8 Flare
IDU Liquid Connection (in., O.D.)	3/8 Flare
IDU Vapor Connection (in., O.D.)	5/8 Flare
Additional Refrigerant (oz./ft.)	0.43
Min/Max. Pipe Length (ft.)	16.4 / 246
Piping Length (no add'l refig., ft.)	24.6
Max. Elevation (ft.)	98.4

#### Features:

- Hot start
- Inverter (variable speed)
- Auto restart
- Control lock
- W2 terminal connection
- Group control
- Timer (on/off)
- Sleep Mode
- Optional Wi-Fi Control
- Built in dry contact
- IDU compatible with Multi F
- ECM (Electronically Commutated Motor) fan provides constant airflow regardless of permitted ESP (External Static Pressure)

#### Required Accessories (sold separately):

Controller (Any LG wired remote controller)

#### Optional Accessories:

- |  |   |
|--|---|
| <input type="checkbox"/> MultiSITE™ CRC2 - PREMTBVC2         | <input type="checkbox"/> Drain Pan Heater - PQSH1200  |
| <input type="checkbox"/> MultiSITE™ CRC2+ - PREMTBVC3        | <input type="checkbox"/> Dry Contact - PDRYCB320  |
| <input type="checkbox"/> MultiSITE™ CRC2+Z - PREMTBVC4       | <input type="checkbox"/> Low Ambient Wind Baffle (cooling operation to -4°F) - ZLABGP04A <sup>9</sup> |
| <input type="checkbox"/> MultiSITE™ Comm. Mgr. - PBACNBTR0A  | <input type="checkbox"/> Electric Heater 3kW - ANEH033B1 <sup>13</sup>                                |
| <input type="checkbox"/> AC Smart 5 - PACS5A000              | <input type="checkbox"/> PI-485 Control Board - PMNFP14A1   |
| <input type="checkbox"/> ACP 5 - PACP5A000                   | <input type="checkbox"/> Downflow Conversion Kit - PNDFJ0   |
| <input type="checkbox"/> Simple Controller - PREMTCC00U      |   |
| <input type="checkbox"/> Wi-Fi module - PWFMD200             |   |
| <input type="checkbox"/> Remote Temperature Sensor - ZRTBS01 |   |
| <input type="checkbox"/> Aux Heater Relay Kit - PRARH1       |   |

For a complete list of available accessories, contact your LG representative.

For continual product development, LG reserves the right to change specifications without notice.

© LG Electronics U.S.A., Inc., Englewood Cliffs, NJ. All rights reserved. "LG Life's Good" is a registered trademark of LG Corp. /www.lghvac.com

#### Operating Range:

##### Outdoor Unit:

Cooling (°F DB)	5 to 118
Heating (°F WB)	-4 to 64

##### Indoor Unit:

Cooling (°F WB)	57 to 77
Heating (°F DB)	59 to 81

#### System Data:

Refrigerant Type/Control	R410A / EEV
Refrigerant Charge (lbs.)	7.5
ODU Sound Pressure Max (Cool / Heat) ±1 dB(A) <sup>3</sup>	52/54
IDU Sound Pressure (H/M/L) ±1 dB(A) <sup>3</sup>	44 / 41 / 39
ODU Net / Shipping Weight (lbs.)	193.1 / 217.4
IDU Net / Shipping Weight (lbs.)	122.4 / 134.0

#### Fan:

ODU / IDU Fan Type	Propeller / Sirocco
Fan Speeds (Fan/Cool/Heat)	3 / 3 / 3
Fan Quantity (ODU + IDU)	2 + 1
Motor/Drive	Electronically Commutated Motor / Direct
Maximum ODU Air Volume (CFM)	1,942 x 2
IDU Air Volume (H/M/L) (CFM)	990 / 880 / 800
Dehumidification Rate (pts/hr) <sup>10</sup>	5.1
IDU External Static Pressure Operating Range (Min~Default~Max) (in-wg) <sup>11</sup>	0.1~ -- 0.7

#### Notes:

1. Acceptable operating voltage: 187V-253V.
2. Piping lengths are equivalent.
3. Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.
4. All power/communication cable to be minimum 14 American wire gage (AWG), 4-conductor, stranded, shielded or unshielded wire and must comply with applicable local and national code. If shielded, the wire must be grounded to the chassis at the outdoor unit only.
5. Power wiring cable size must comply with the applicable local and national code.
6. The indoor unit comes with a dry helium charge.
7. This data is rated 0 ft. above sea level, with 25 ft. of refrigerant line and a 0 ft. level difference between outdoor and indoor units.
8. Must follow installation instructions in the applicable LG installation manual.
9. If the optional low ambient wind baffle (ZLABGP04A) is used, one wind baffle is required for each ODU fan.
10. Dehumidification rate is based on high speed airflow.
11. 18k, 24k, and 36k IDU units have ECM fan that automatically adjusts throughout the ESP (External Static Pressure) range. Therefore, there is no default ESP value for these units.
12. 18k and 24k Vertical Air Handler Units are supplied with socket adapters for pipe transitions.
13. Electric heater accessory available in 3kW, 5kW, 8kW, and 10kW capacities. Refer to the engineering manual for details.
14. Controller not included.



Proper sizing and installation of equipment is critical to achieve optimal performance. Split system air conditioners and heat pumps (excluding ductless systems) must be matched with appropriate coil components to meet ENERGY STAR® criteria. Ask your contractor for details or visit www.energystar.gov. (ENERGY STAR and the ENERGY STAR mark are registered trademarks owned by the U.S. Environmental Protection Agency.)



SB\_SZ\_VAHU\_NJ\_LV361HV\_2023\_12\_15\_165437

# LVN361HV4


## Single Zone Vertical Air Handling Unit



Tag No.: \_\_\_\_\_

Date: \_\_\_\_\_

PO No.: \_\_\_\_\_

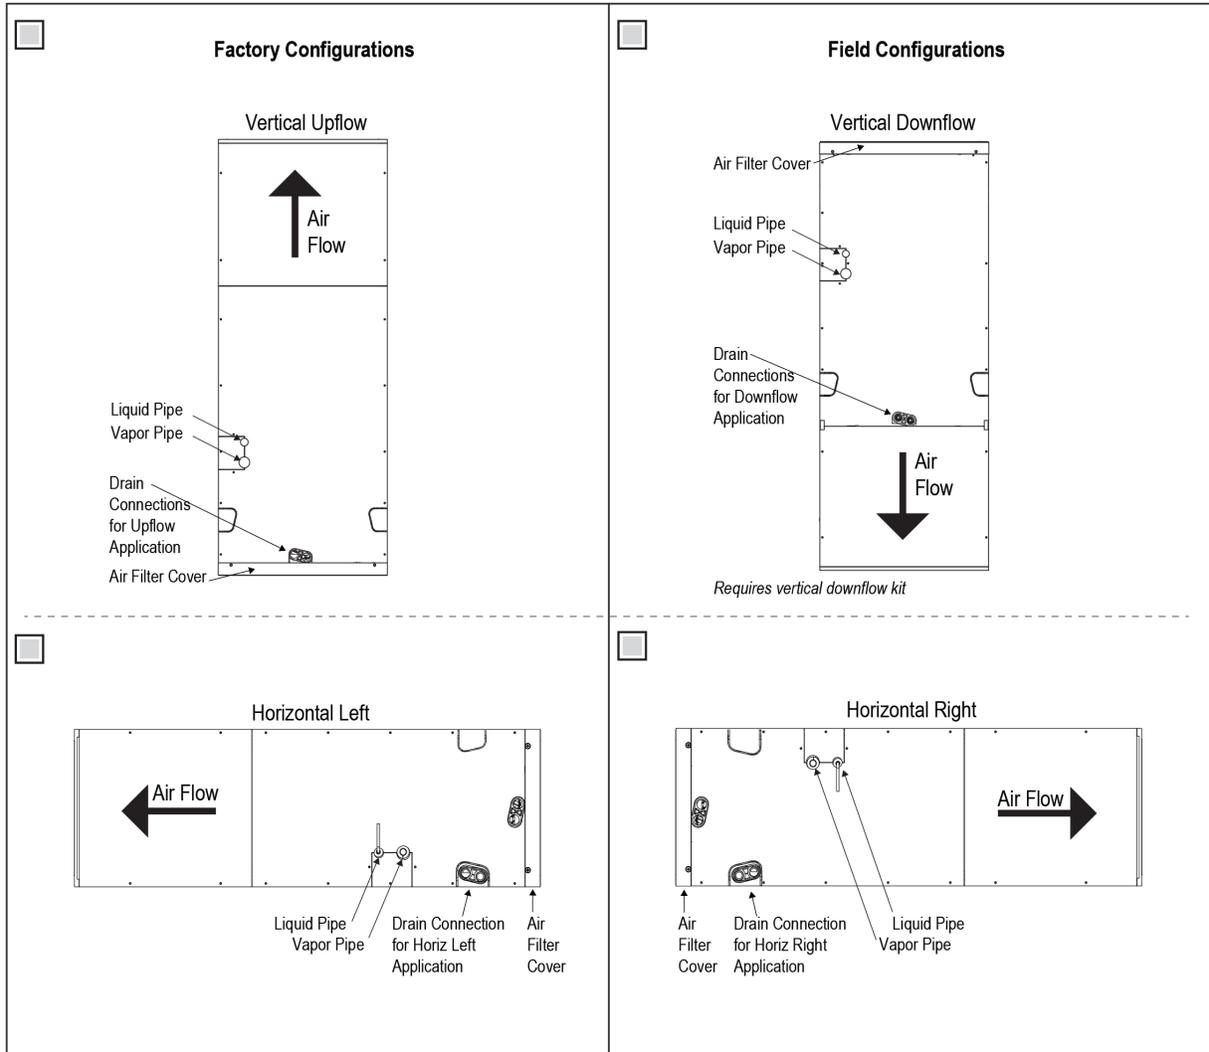

# LUU360HV


## Single Zone Vertical Air Handling Unit



Tag No.: \_\_\_\_\_

Date: \_\_\_\_\_

PO No.: \_\_\_\_\_

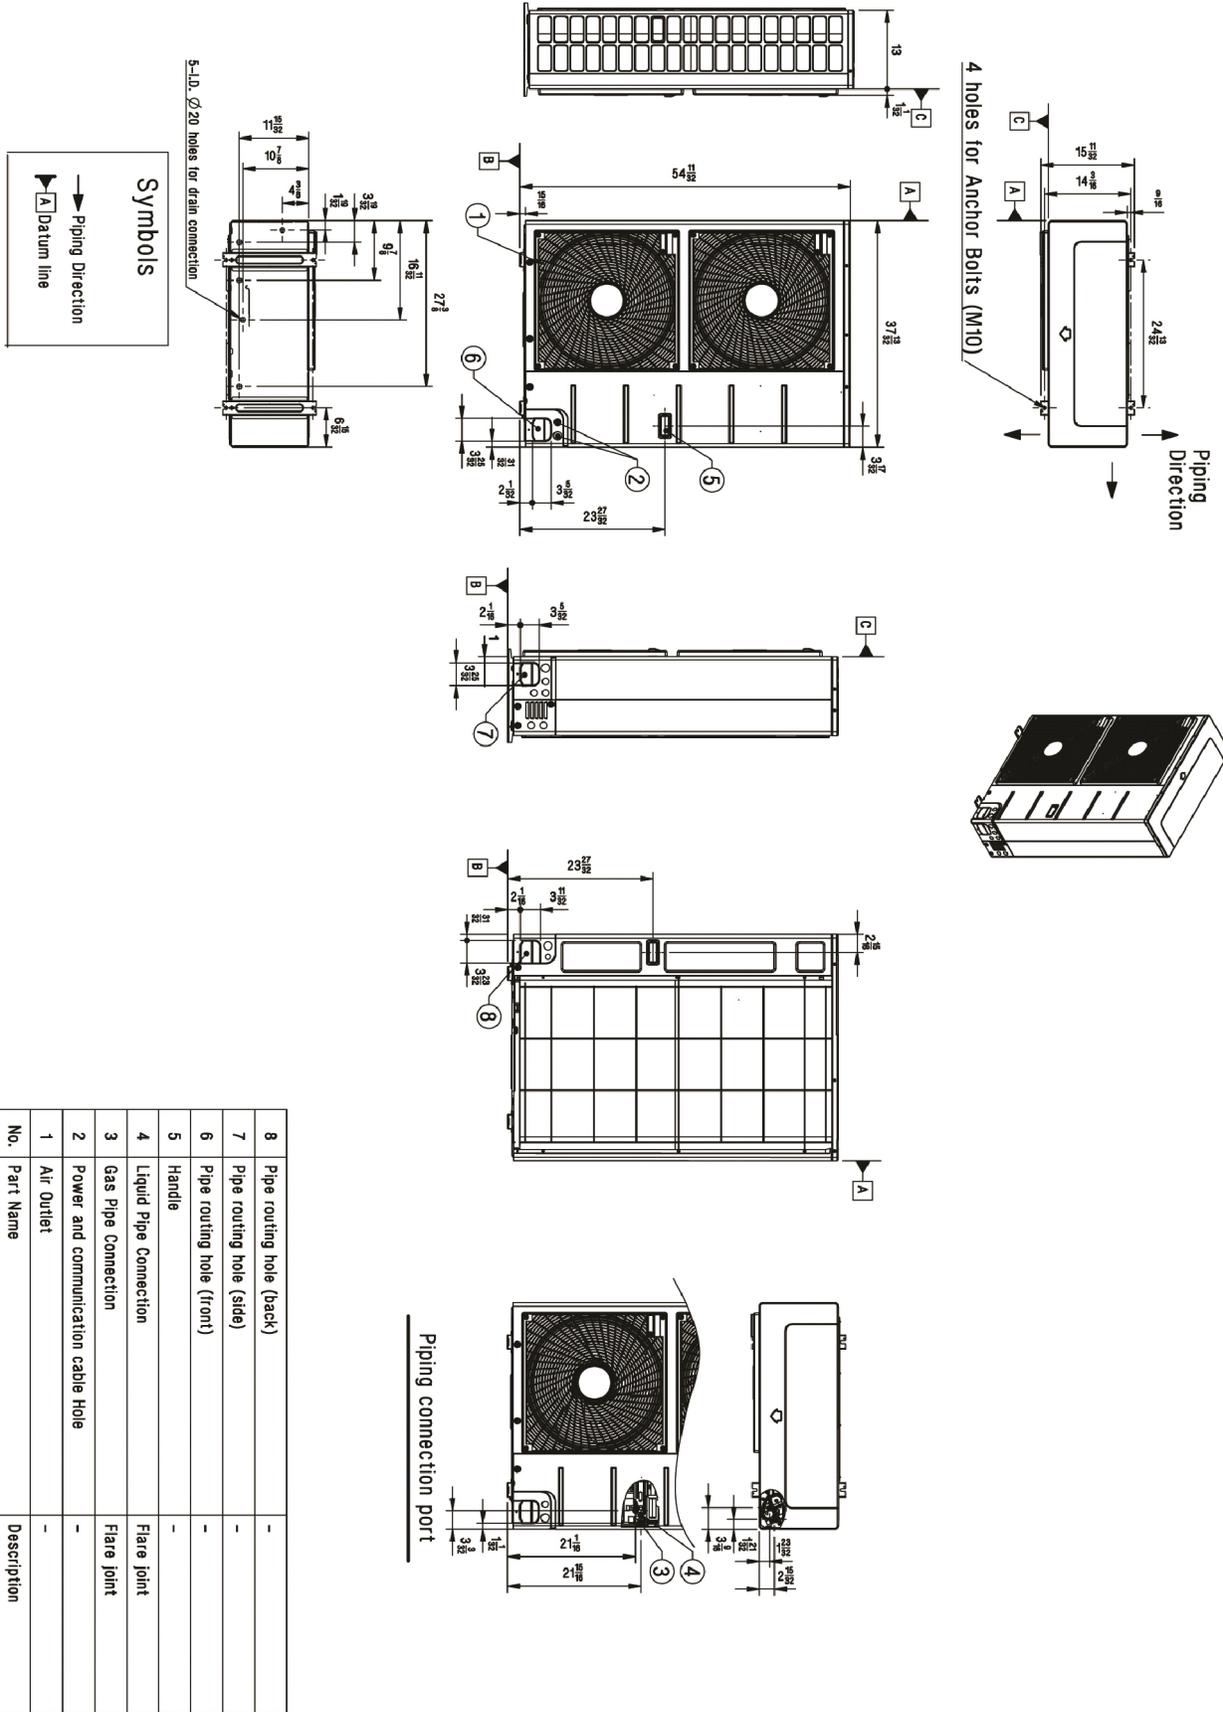


**LVN361HV4**  
Single Zone Vertical Air Handling Unit




Tag No.: \_\_\_\_\_

Date: \_\_\_\_\_

PO No.: \_\_\_\_\_

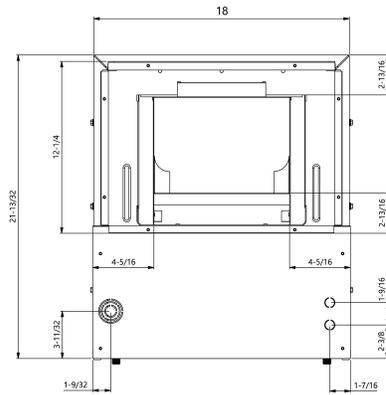


Top View

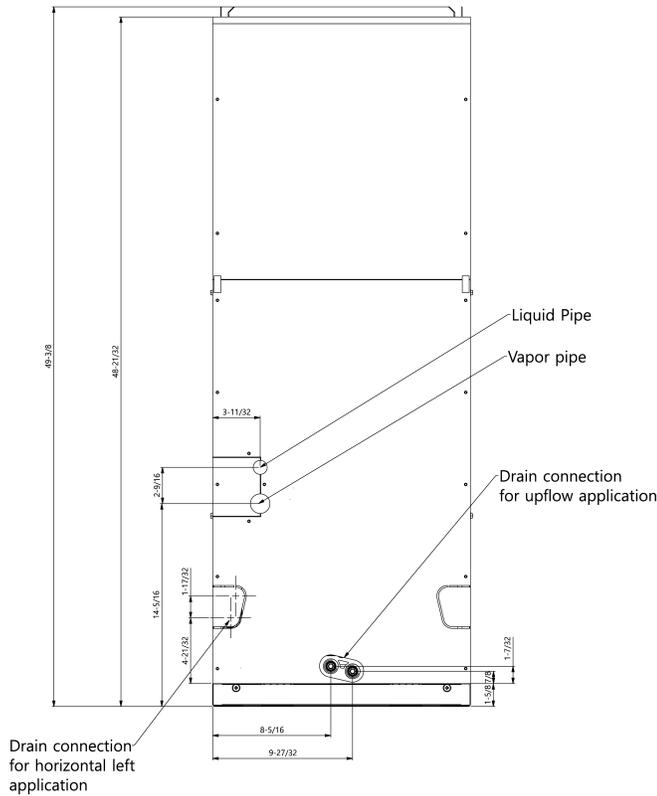

Front View



Side View

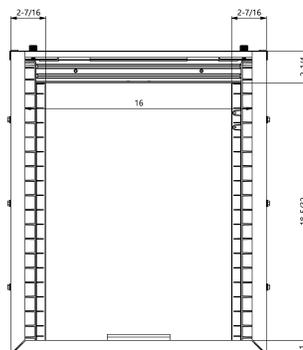

Bottom View