

Job Name/Location:

Tag No.:

Date:

For: File Resubmit

PO No.:

Approval Other

Architect: GC:

Engr: Mech:

Rep:

(Company)

(Project Manager)

**KSSMB36BA****R32 Standard Single-Zone System - A-Coil**

Outdoor Unit (ODU) - KUSXB361A, A-Coil Unit - LKMMMA36B1

**Performance:****Cooling:**

|                                          |                      |
|------------------------------------------|----------------------|
| Cooling Capacity (Min~Rated~Max) (Btu/h) | 13,100~34,400~36,000 |
| SEER2                                    | 15.2                 |
| EER2                                     | 11.70                |

SEER - Seasonal Energy Efficiency Ratio

EER - Energy Efficiency Ratio

**Heating:**

|                                          |                      |
|------------------------------------------|----------------------|
| Heating Capacity (Min~Rated~Max) (Btu/h) | 15,200~37,000~38,000 |
| HSPF2                                    | 8.4                  |
| Max. Heating @ Indoor 70°F DB            |                      |
| Outdoor 17°F WB                          | 35,500               |
| Outdoor 5°F WB                           | 32,000               |
| Outdoor -4°F WB                          | 29,100               |

HSPF - Heating Seasonal Performance Factor

**Electrical:**

|                                                |                |
|------------------------------------------------|----------------|
| Power Supply (V/Hz/Ø)                          | 208-230/60/1   |
| MOP (A)                                        | 35             |
| MCA (A)                                        | 32             |
| Cooling Rated Amps (A)                         | 12.9           |
| Heating Rated Amps (A)                         | 14.4           |
| Compressor (A)                                 | 22.0           |
| Fan Motor (ODU) (A)                            | 1.6            |
| Cooling Power Input (Min~Rated~Max @95°F) (kW) | 1.03~2.94~3.27 |
| Heating Power Input (Min~Rated~Max @47°F) (kW) | 0.92~3.29~3.55 |

MOP - Maximum Overcurrent Protection

MCA - Minimum Circuit Ampacity

**Outdoor Unit Piping:**

|                                            |            |
|--------------------------------------------|------------|
| Liquid (in., O.D.) <sup>2</sup>            | 3/8 Flare  |
| Vapor (in., O.D.) <sup>2</sup>             | 5/8 Flare  |
| Additional Refrigerant (oz./ft.)           | 0.43       |
| Min. / Max. Pipe Length (ft.) <sup>3</sup> | 16.4 / 246 |
| Piping Length (no add'l refriger., ft.)    | 24.6       |
| Max. Elevation (ft.)                       | 98.4       |

**A-Coil Features:**

- Aluminum Coil
- Fully Insulated Cabinet
- High Efficiency "A" Coil
- Built-in plenum flanges for fast and safe installation
- Multi-Position Installation: Vertical, Downflow, or Horizontal
- Vertical and Horizontal Drain Pans
- Left and Right Drain Connections
- Factory installed TXV's with bolt on connections
- Factory installed Refrigerant Detection sensor

**Outdoor Unit Features:**

- Inverter (Variable Speed) Compressor
- Built-in Communication Kit

**Optional Accessories:**

- ☐ LG Airzone Aidoo Pro Wi-Fi Controller - AZAI6WSPLGE
- ☐ Drain Pan Heater - PQSH1200
- ☐ Single-Port Shutoff Valve - PRHPZ010A
- ☐ Low Ambient Wind Baffle (Cooling operation to -4°F) - ZLABGP04B Requires 2

**Outdoor Unit Operating Range:**

|                 |          |
|-----------------|----------|
| Cooling (°F DB) | 5 ~ 118  |
| Heating (°F WB) | -4 ~ +64 |

**Outdoor Unit Data:**

|                                                            |                         |
|------------------------------------------------------------|-------------------------|
| Compressor Type x Qty.                                     | R1 Scroll x 1           |
| Refrigerant Type                                           | R32                     |
| Refrigerant Control                                        | EEV - ODU, TXV - A-Coil |
| Pre-Charge + Additional Charge for A-Coil (lbs.)           | 6.63 + 0.88             |
| Sound Pressure (Cooling / Heating) (±1 dB[A]) <sup>4</sup> | 52 / 54                 |
| Net / Shipping Weight (lbs.)                               | 190.2 / 214.3           |

**A-Coil Unit Data:**

|                                        |                  |
|----------------------------------------|------------------|
| Nominal Capacity (Btu/h)               | 34,400           |
| Type                                   | 17.5 inch        |
| Coil Material                          | Aluminum         |
| Case Width x Height x Depth (in.)      | 17-1/2 x 26 x 21 |
| Net / Shipping Weight (lbs.)           | 54 / 60          |
| Liquid Piping (in., O.D.) <sup>2</sup> | 3/8 Braze        |
| Vapor Piping (in., O.D.) <sup>2</sup>  | 3/4 Braze        |

**Fan:**

|                                                   |                                       |
|---------------------------------------------------|---------------------------------------|
| ODU Fan Type x Qty.                               | Axial x 2                             |
| ODU Fan Speeds (Fan/Cool/Heat)                    | 4 / 5 / 5                             |
| ODU Motor/Drive                                   | Brushless Digitally Controlled/Direct |
| ODU Air Flow Rate (CFM)                           | 1,942 x 2                             |
| Air Flow Range through A-Coil (CFM) (Min. ~ Max.) | 840~1,200                             |
| Corresponding ESP Range (in. w.g.) (Min. ~ Max.)  | 0.1~0.8                               |
| Dehumidification (pts./hr.)                       | 7.17                                  |

**Notes:**

- Acceptable operating voltage: 187V-253V.
- Adapters for piping connections are shipped with the outdoor unit.
- Piping lengths are equivalent.
- Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.
- All power supply wiring to the outdoor unit is field supplied, solid or stranded. The power wiring and the communication wiring from the outdoor unit to the third-party, field-supplied furnace is field supplied and must be stranded, shielded or unshielded (if shielded, it must be grounded to the chassis of the outdoor unit only). All wiring must comply with applicable local and national codes.
  - Power Supply Wiring to Outdoor Unit (No. x AWG): 3 x 12 for 18k and 24k; 3 x 10 for 30k, 36k, 42k, 48k, and 60k.
  - Power Supply Wiring to the third-party Furnace is to be specified by the manufacturer.
  - Control Cable between the Outdoor Unit and the third-party Furnace (No. x AWG): 6 x 18.
  - The 24V Control Power to the A-Coil is to be sourced from the third-party Furnace.
  - The Control Cable between the third-party Furnace and the thermostat (No. x AWG): 6 x 18.
- Nominal data is rated 0 ft. above sea level, with 25 ft. of refrigerant line and a 0 ft. level difference between outdoor and indoor units.
- Must follow installation instructions in the applicable LG installation manual.





**KSSMB36BA**

**R32 Standard Single-Zone System - A-Coil**

Outdoor Unit (ODU) - KUSXB361A, A-Coil Unit - LKMMMA36B1



Tag No.: \_\_\_\_\_

Date: \_\_\_\_\_



PO No.: \_\_\_\_\_

LKMMMA30B1, LKMMMA36B1

4MC Cased Coil Assembly (Left)

4MC Coil Assembly

ABS  
Horizontal  
Pan

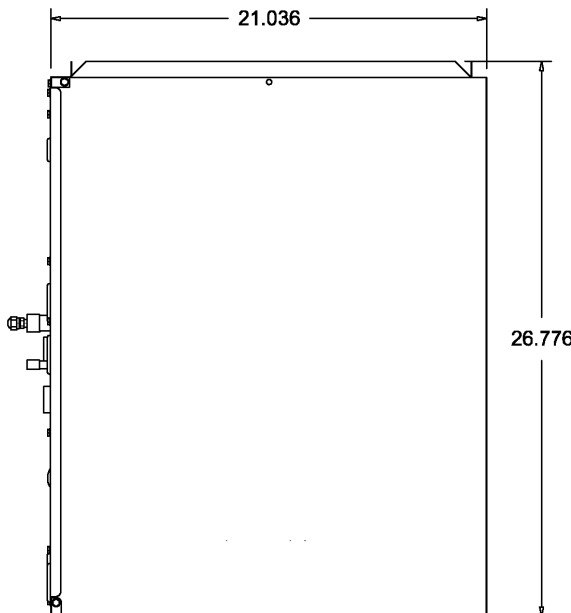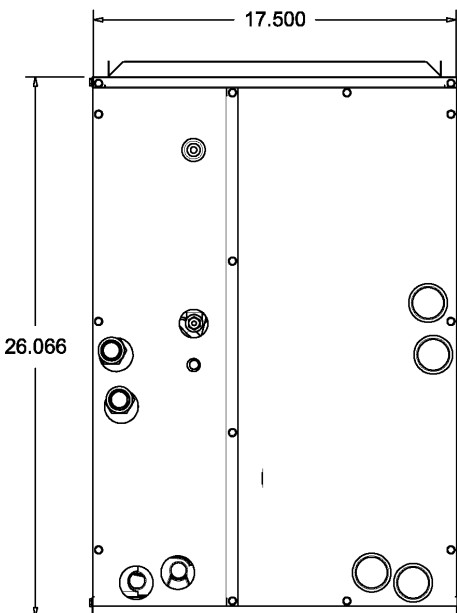

UNLESS OTHERWISE SPECIFIED:

ALL BENDS 90 DEGREES.  
ANGLES +/- 2 DEGREES.  
ALL HOLE SIZES +/- .010  
ALL HOLE TO HOLE DIM. +/- .015  
XX +/- .125  
XXX +/- .063  
XXXX +/- .032

THICKNESS