For: File Resubmit Date: **Approval** Other. PO No.: GC: Architect: Mech: Engr: Rep:

(Project Manager)



Tag No.:



LA120HYV3

Job Name/Location:

Art Cool™ Premier Single Zone Inverter

Outdoor Unit (ODU) - LAU120HYV3 Indoor Unit (IDU) - LAN120HYV3



Performance:

Cooling:

Cooling Capacity (Min~Rated~Max) (Btu/h)	1,023 ~ 12,000 ~ 13,785
SEER2	25.5
EER2	13.8

SEER - Seasonal Energy Efficiency Ratio EER - Energy Efficiency Ratio

Heating:

Heating Capacity	
(Min~Rated~Max) (Btu/h)	1,023 ~ 13,600 ~ 22,178
HSPF2	11.2
Max. Heating @ Indoor 70°F DB	14.760
Outdoor 17°F WB	', '
Outdoor 5°F WB	13.600
Outdoor -13°F WB	9,640

HSPF - Heating Seasonal Performance Factor

Heating Nominal Test Conditions: Indoor: 70°F DB / 60°F WB Outdoor: 47°F DB / 43°F WB Cooling Nominal Test Conditions: Indoor: 80°F DB / 67°F WB Outdoor: 95°F DB / 75°F WB

Outdoor Unit:

MOP (A)		15
MCA (A)		11.2
Cooling / Heating Rated Amps (A)		8.7/8.7
Compressor (A)		8.3
Fan Motor (A)		0.4
MOP - Maximum Overcurrent Protection	MCA - Minimum Circuit Ampacity	

Total Power Input:

Cooling Power Input (kW)	0.87
Heating Power Input (kW)	0.97

Piping:

Liquid Line (in., O.D.)	1/4
Vapor Line (in., O.D.)	3/8
Additional Refrigerant (oz./ft.)	0.22
Min. / Max. Pipe Length (ft.) ²	9.8 / 65.6
Piping Length (no add'l refrig., ft.)	24.6
Max. Elevation (ft.)	39.4

Features:

- 24-Hour on/off timer
- 4-Way auto swing
- Auto restart / changeover
- · Jet cool/Jet heat
- Built-in low ambient standard, down to 14°F (cooling mode)
- Chaos Wind
- nection
- Defrost Control
- Dehumidifying Mode
- Hot Start • Inverter (variable speed
- compressor) • Smart Diagnosis
- Condensate Sensor Con-
 - · Washable Filter
 - Soft Dry Operation
 - Self-cleaning indoor coil • Built-in base pan heater
 - Cooling only/heating only
 - function • Built-in Wi-Fi via Smart

ThinQ app

Optional Accessories:



☐ Simple Remote Controller - PREMTC00U ☐ Dry Contact - PDRYCB100/320/400 ☐ AC Smart 5 - PACS5A000

☐ ACP 5 - PACP5A000

☐ Low Ambient Wind Baffle (Cooling operation to 0°F) - ZLABGP03A

Proper sizing and installation of equipment is critical to achieve optimal performance. Split system air conditioners and heat pumps (excluding ductless systems) must be matched with appropriate coil components to meet ENERGY STAR® criteria. Ask your contractor for details or visit www.energystar.gov.

(ENERGY STAR and the ENERGY STAR mark are registered trademarks owned by the U.S. Environmental Protection Agency.)

Operating Range:

Outdoor Unit:

(Cooling (°F DB)	14 ~ 118
H	Heating (°F WB)	-13 ~ +65
Īr	ndoor Unit:	
	Cooling (°F WB)	53 ~ 75
	Heating (°F DB)	60 ~ 86

Electrical:

Power Supply (V¹/Hz/Ø)	208-230/60/1
11 0 11 C. Supply (1 / 1 1 2 / 12 / 12 / 12 / 12 / 12 / 1	200 200/00/1

System Data:

Refrigerant Type	R410A
Refrigerant Control	EEV
Refrigerant Charge (lbs.)	2.54
ODU Sound Pressure	
(Max., Cool / Heat) (±1 dB[A]) ³	48/50
IDU Sound Pressure	
Cooling (H/M/L/Sleep) (±1 dB[A]) ³	42/36/26/22
Heating (H/M/L) (±1 dB[A]) ³	42/36/26
ODU Net / Shipping Weight (lbs.)	93.9/103.2
IDU Net / Shipping Weight (lbs.)	25.1/29.5
Heat Exchanger Coating	GoldFin™

Fan:

ODU Type	Propeller
IDU Type	Cross Flow
Fan Speeds (Fan/Cool/Heat)	6/6/6
Quantity (ODU + IDU)	1+1
Motor/Drive	Brushless Digitally Controlled/Direct
ODU Max. Air Flow Rate (CFM)	1730
IDU Air Flow	
Cooling, Max/H/M/L (CFM)	530 / 424 / 353 / 184
Heating, Max/H/M/L (CFM)	530 / 424 / 353 / 184
Dehumidification (pts./hr.)	3.59

Notes:

- Acceptable operating voltage: 187V-253V.

- 1. Acceptable operating voltage: 187V-253V.
 2. Piping lengths are equivalent.
 3. Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.
 4. All communication / connection (power) cable from the outdoor unit to the indoor unit is field supplied and must be a minimum of four-conductor, 14 AWG, stranded, shielded or unshielded (if shielded, it must be grounded to the chassis of the outdoor unit only), and must comply with applicable local and national codes.
 5. See Engineering Manual for sensible and latent capacities.
 6. Power wiring cable size must comply with the applicable local and national code.
 7. The indoor unit comes with a dry helium charge.
 8. This data is rated 0 ft. above sea level, with 24.6 ft. of refrigerant line and a 0 ft. level difference between outdoor and indoor units.
 9. Must follow installation instructions in the applicable LG installation manual.












LA120HYV3

Art Cool™ Premier Single Zone Inverter
Outdoor Unit (ODU) - LAU120HYV3 Indoor Unit (IDU) - LAN120HYV3



Tag No.: ______
Date:

PO No.:

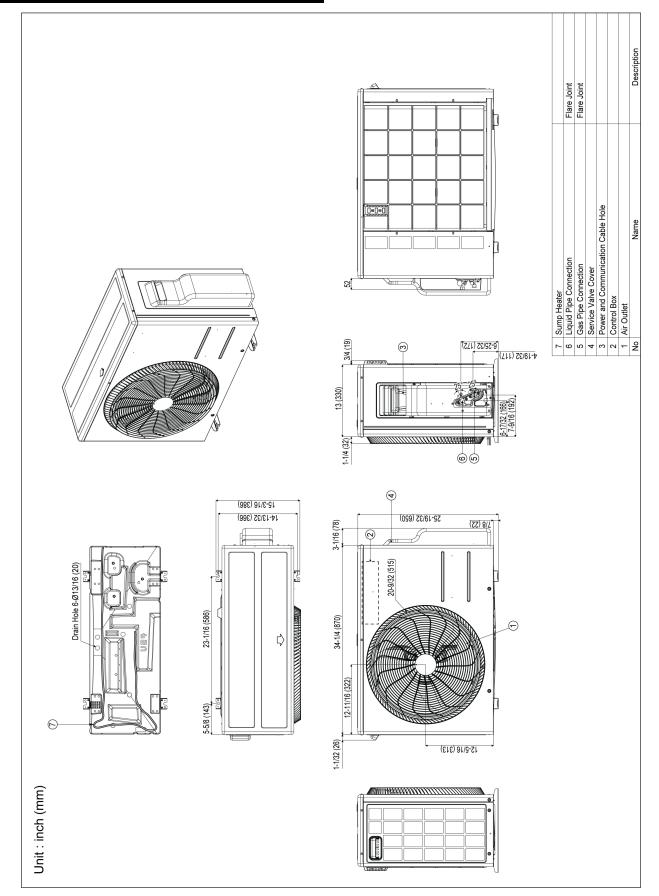

LA120HYV3

Art Cool™ Premier Single Zone Inverter
Outdoor Unit (ODU) - LAU120HYV3 Indoor Unit (IDU) - LAN120HYV3

