

Job Name/Location:

Tag No:

Date:

For: File Resubmit
Approval Other

PO No.:



Architect: GC:

Engr: Mech:

Rep: (Company) (Project Manager)



KSUFB091A

R32 Single-Zone One-Way Ceiling Cassette

Indoor Unit (IDU) - KNUFB091A, Outdoor Unit (ODU) - KUSXB091A

Performance:

Cooling:

| | |
|--|-------------------|
| Cooling Capacity (Min~Rated~Max) (Btu/h) | 3,400-9,000-9,900 |
| SEER2 | 20.2 |
| EER2 | 12.61 |

SEER - Seasonal Energy Efficiency Ratio EER - Energy Efficiency Ratio

Heating:

| | |
|--|---------------------|
| Heating Capacity (Min~Rated~Max) (Btu/h) | 2,800-12,000-15,000 |
| HSPF2 | 10.4 |
| Max. Heating @ Indoor 70°F DB | |
| Outdoor 17°F WB | 11,600 |
| Outdoor 5°F WB | 8,800 |
| Outdoor -4°F WB | 7,700 |

HSPF - Heating Seasonal Performance Factor

Electrical:

| | |
|--|-----------------|
| Power Supply (V/Hz/Ø) | 208-230/60/1 |
| MOP (A) | 15 |
| MCA (A) | 13.4 |
| Cooling Rated Amps (A) | 0.8-3.1-3.6 |
| Heating Rated Amps (A) | 0.6-3.9-5.9 |
| Compressor (A) | 9 |
| Fan Motor (IDU + ODU) (A) | 0.58 + 0.4 |
| Cooling Power Input (Min~Rated~Max @95°F) (kW) | 0.18-0.714-0.83 |
| Heating Power Input (Min~Rated~Max @47°F) (kW) | 0.13-0.880-1.35 |

MOP - Maximum Overcurrent Protection MCA - Minimum Circuit Ampacity

Piping:

| | |
|--|-----------|
| Liquid (ODU, in., Connection Size/Pipe Size) | 1/4 / 1/4 |
| Vapor (ODU, in., Connection Size/Pipe Size) | 3/8 / 3/8 |
| Liquid (IDU, in., Connection Pipe Size) | 1/4 |
| Vapor (IDU, in., Connection Pipe Size) | 3/8 |
| Additional Refrigerant (oz./ft.) | 0.22 |
| Max. Pipe Length (ft.) ² | 65.6 |
| Piping Length (no add'l refrig., ft.) | 24.6 |
| Max. Elevation (ft.) | 49.2 |

Features:

- Inverter (Variable Speed) Compressor
- Internal Condensate Pump
- Jet Cool / Jet Heat
- IDU compatible with Multi F ODUs
- Ultra-quiet Turbo Fan
- Auto Restart / Auto Operation
- R32 Leak Detection Sensor
- Built-in Wi-Fi via Smart ThinQ app

Included Accessories:

- Wireless Remote Controller — AKB75735426

Required Accessories:

- Panel (50" x 16-7/32") - PT-UCA

Optional Accessories:

- Auxiliary Heater Kit - PRARH1
- Single-Port Shutoff Valve - PRHPZ010A
- R32 Alarm Kit - PLDCAA05
- Low Ambient Wind Baffle (Cooling operation to -4°F) - ZLABGP01A
- Drain Pan Heater - PQSH1202

Controller Options:

- MultiSITE™ CRC* Controllers
- Simple Remote Controllers
- Standard III Remote Controllers
- Deluxe Remote Controller
- Remote Temperature Button Sensor
- Dry Contacts
- AC Smart 5 Central Controller
- LonWorks® Gateway
- MultiSITE Comm. Mgr.
- ACP 5 BACnet™ Gateway

BACnet™ is a registered trademark of ASHRAE. LonWorks® is a trademark of Echelon Corporation.

For a complete list of available accessories, contact your LG representative.

For continual product development, LG reserves the right to change specifications without notice.

© LG Electronics U.S.A., Inc., Englewood Cliffs, NJ. All rights reserved. "LG Life's Good" is a registered trademark of LG Corp. /www.lghvac.com

Operating Range:

Outdoor Unit:

| | |
|-----------------|----------|
| Cooling (°F DB) | 5 ~ 118 |
| Heating (°F WB) | -4 ~ +64 |

Indoor Unit:

| | |
|-----------------|---------|
| Cooling (°F WB) | 57 ~ 77 |
| Heating (°F DB) | 59 ~ 81 |

System Data:

| | |
|---|-------------------|
| Refrigerant Type | R32 |
| Refrigerant Control | EEV |
| Refrigerant Charge (lbs.) | 2.43 |
| ODU Sound Pressure Max. (Cooling / Heating) (±3 dB[A]) ³ | 47 / 51 |
| IDU Sound Pressure (Cool / Heat) (Max./H/M/L) (±3 dB[A]) ³ | 35 / 33 / 31 / 30 |
| ODU Net / Shipping Weight (lbs.) | 75 / 79.4 |
| IDU Net / Shipping Weight (lbs.) | 30.4 / 37 |
| Grille Net / Shipping Weight (lbs.) | 10.8 / 13.9 |
| Heat Exchanger Coating | GoldFin™ |

Fan:

| | |
|--------------------------------|---------------------------------------|
| ODU Type | Axial |
| IDU Type | Cross Flow |
| Fan Speeds (Fan/Cool/Heat) | 4 / 5 / 5 |
| Quantity (ODU + IDU) | 1 + 1 |
| Motor/Drive | Brushless Digitally Controlled/Direct |
| Max. ODU Air Flow Rate (CFM) | 988 |
| IDU Air Flow (CFM, Max./H/M/L) | 353 / 325 / 300 / 289 |
| Dehumidification (pts./hr.) | 2.4 |

Notes:

- Acceptable operating voltage: 187V-253V.
- Piping lengths are equivalent.
- Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.
- All power supply wiring to the outdoor unit is field supplied, solid or stranded. The power wiring and the communication wiring from the outdoor unit to the indoor unit is field supplied and must be stranded, shielded or unshielded (if shielded, it must be grounded to the chassis of the outdoor unit only). All wiring must comply with applicable local and national codes.
 - Power Supply Wiring to Outdoor Unit (No. x AWG): 3 x 12 for 9k, 12k, and 18k.
 - Power Wiring and Communication Wiring from Outdoor Unit to Indoor Unit (No. x AWG) 3 x 14 / 2 x 18.
- This unit comes with a dry helium charge.
- Nominal data is rated 0 ft. above sea level, with 25 ft. of refrigerant line and a 0 ft. level difference between outdoor and indoor units.
- Must follow installation instructions in the applicable LG installation manual.
- Multi-compatible IDUs include socket adapters for refrigerant pipe connection with Single Zone systems.



Proper sizing and installation of equipment is critical to achieve optimal performance. Split system air conditioners and heat pumps (excluding ductless systems) must be matched with appropriate coil components to meet ENERGY STAR® criteria. Ask your contractor for details or visit www.energystar.gov. (ENERGY STAR and the ENERGY STAR mark are registered trademarks owned by the U.S. Environmental Protection Agency.)

KSUFB091A R32 Single-Zone One-Way Ceiling Cassette

Indoor Unit (IDU) - KNUFB091A, Outdoor Unit (ODU) - KUSXB091A




Tag No.: _____

Date: _____

PO No.: _____

Unit: inch
Model: KUSXB091A, KUSXB121A

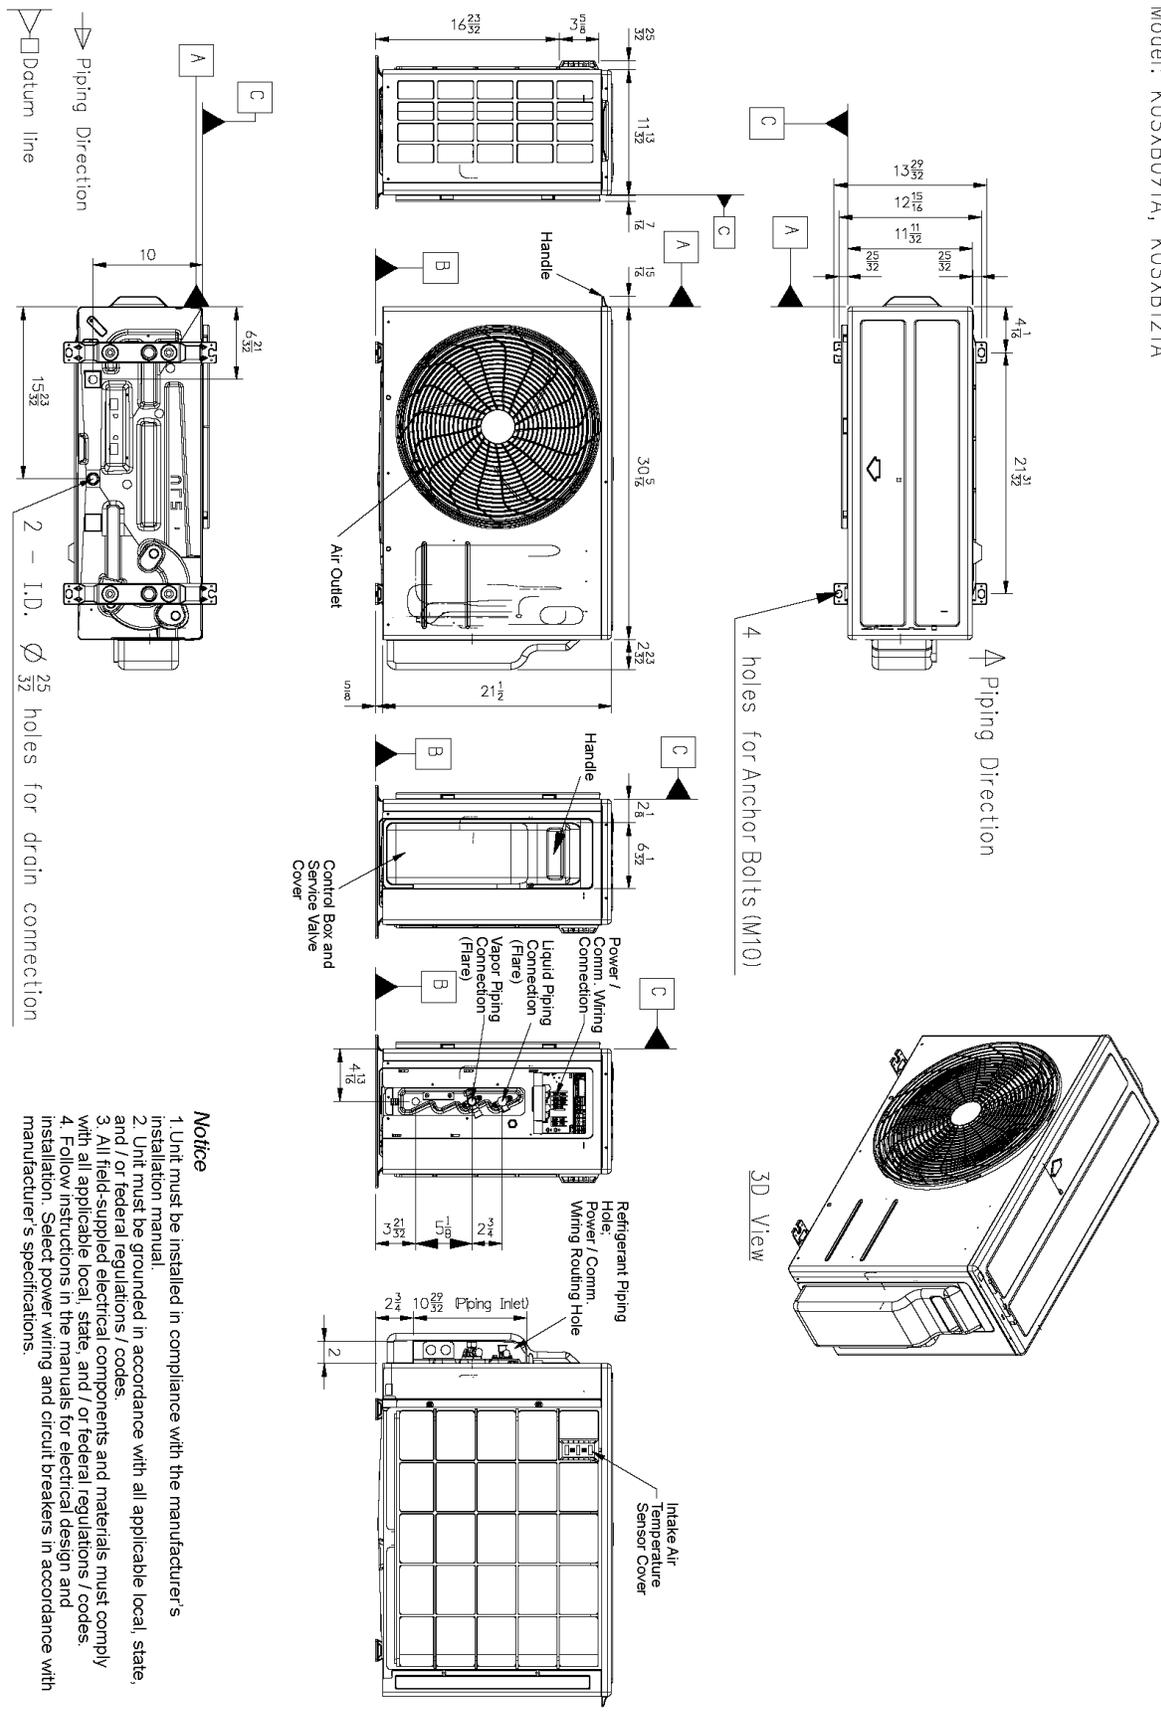

Notice

1. Unit must be installed in compliance with the manufacturer's installation manual.
2. Unit must be grounded in accordance with all applicable local, state, and / or federal regulations / codes.
3. All field-supplied electrical components and materials must comply with all applicable local, state, and / or federal regulations / codes.
4. Follow instructions in the manuals for electrical design and installation. Select power wiring and circuit breakers in accordance with manufacturer's specifications.

Job Name/Location: _____

KSUFB091A

R32 Single-Zone One-Way Ceiling Cassette

Indoor Unit (IDU) - KNUFB091A, Outdoor Unit (ODU) - KUSXB091A



Tag No.: _____

Date: _____

PO No.: _____

Unit : inch
Chassis Code : TC

