

Job Name/Location:

Tag No.:

Date:

| | | |
|------|----------|------------|
| For: | File | Resubmit |
| | Approval | Other_____ |

PO No.:

Architect: GC:

Engr: Mech:

Rep: (Company) (Project Manager)



ZRNU423NBAA
R32 Multi V™ Multi-Position Air Handling Unit
 42,000 Btu/h Indoor Unit

Performance:

| | |
|---|-----------------|
| Total Cooling Capacity (Btu/h) ¹ | 42,000 |
| Heating Capacity (Btu/h) ¹ | 46,000 |
| Max Power Input (W) ² | 366 |
| L/M/H Power Input at Factory Default (W) | 147 / 187 / 260 |

Rated capacity is certified under the latest AHRI Standard 1230-2023. Ratings are subject to change without notice. Current and past certified ratings are available at www.ahridirectory.org.

Electrical:

| | |
|-----------------------|--------------|
| Power Supply (V/Hz/Ø) | 208-230/60/1 |
| Rated Amps | 3.4 |

Piping:

Refrigerant:

| | |
|-------------------------|-----------|
| Liquid Line (in., O.D.) | 3/8 braze |
| Vapor Line (in., O.D.) | 5/8 braze |

Condensate:

| | |
|--------------------------------|-------------|
| Condensate Drain (in., I.D.) | 1 |
| Gravity Drain Plugged (in, OD) | 1 (3/4 MPT) |

Controls Features:

- Auto changeover (Heat Recovery only)
- Auto operation
- Auto restart
- Auto fan
- Dual thermistor control
- Wi-Fi compatible
- Weekly schedule
- Dual setpoint control
- Multiple auxiliary heater applications
- Filter life display
- External on/off control
- R32 leak detection sensor
- Fan speed control
- Group control
- Hot start
- Self diagnostics
- Timer (on/off)
- Child lock

Standard Features:

- Access Panel for Field Supplied Air Filter - 20 x 20 x 1

Optional Accessories:

- Auxiliary Heater Kit³ - PRARH1
- Wi-Fi Module - PWFMD200
- Downflow Conversion Kit - PNDFAO
- Electric Heat Kits - ANEHxx3Cx⁴

Controller Options:

- MultiSITE™ CRC2* Controllers
- Simple Remote Controllers
- Standard III Remote Controllers
- Deluxe Remote Controllers
- Remote Temperature Button Sensors
- Dry Contacts



Entering Mixed Air:

| | |
|--------------------------------------|----|
| Cooling Maximum ¹ (°F WB) | 76 |
| Heating Minimum (°F DB) | 59 |

Unit Data:

| | |
|---|--------------|
| Refrigerant Type | R32 |
| Refrigerant Control | EEV |
| Sound Pressure ⁵ dB(A) (H/M/L) | 41 / 38 / 36 |
| Sound Power ⁶ dB(A) (H) | 57 / 55 / 54 |
| Filter Type | Washable |
| MERV | N/A |
| Filter Quantity | 1 |
| Filter Dimensions ⁷ (in) | 20 x 20 x 1 |
| Unit Net Weight (lbs.) | 145 |
| Unit Shipping Weight (lbs.) | 160 |

Fan:

| | |
|---|---------------------------------------|
| Fan Type / Quantity | Sirocco / 1 |
| Motor/Drive | Brushless Digitally Controlled/Direct |
| Motor Quantity | 1 |
| Factory Set External Static Pressure (ESP) ⁸ (in wg) | 0.5 |
| Factory Set Air Flow Rate H/M/L (CFM) | 1,225 / 1,100 / 1,000 |
| Minimum ESP (in wg) ⁹ | 0.1 |
| Maximum ESP (in wg) ⁹ | 1.0 |

Notes:

1. See Engineering Manual for sensible and latent capacities.
2. Maximum power input is rated at maximum setting value.
3. If a Third-Party Dry Contact and an LG internal heater or an LG Auxiliary Heater Kit is installed, supplemental heat capability cannot be controlled by the Third-Party Thermostat.
4. Refer to the Engineering Manual for available auxiliary heater capacities.
5. Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.
6. Sound Power levels are tested in a reverberation chamber under ISO Standard 3741.
7. Actual filter sizes may vary.
8. At factory fan speed setting.
9. Maximum static pressure may result in reduced airflow (CFM).
10. Communication cable between (main) outdoor unit to indoor units/heat recovery units to be 18 AWG, 2-conductor, twisted, stranded, shielded. Ensure the communication cable shield is properly grounded to the (main) outdoor unit chassis only. ⚠ DO NOT ground the outdoor unit to indoor units / heat recovery units communication cable at any other point. Wiring must comply with all applicable local and national codes.
11. Power wiring is field provided, and must comply with the applicable local and national codes.
12. This unit comes with a dry nitrogen charge.
13. All capacities are net with a combination ratio between 95 – 105%.
14. Must follow installation instructions in the applicable LG installation manual.

Job Name/Location: _____


ZRNU423NBAA
R32 Multi V™ Multi-Position Air Handling Unit
42,000 Btu/h Indoor Unit



Tag No.: _____

Date: _____

PO No.: _____

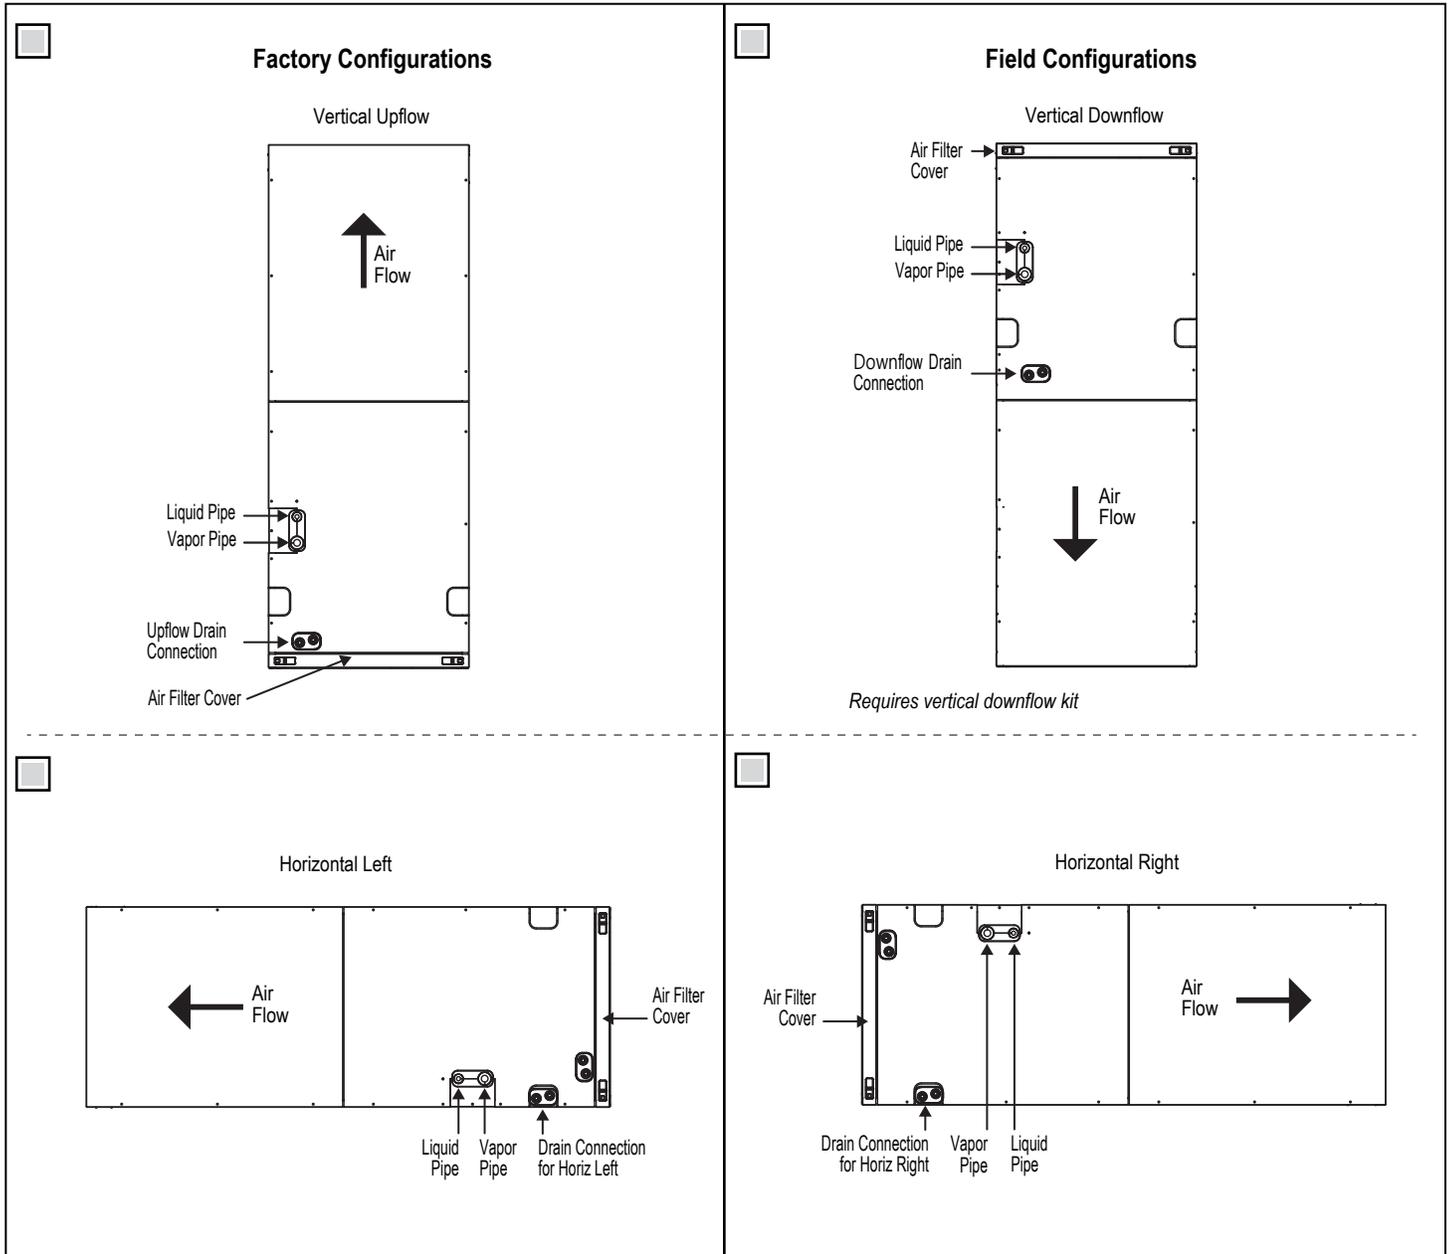

Job Name/Location: _____

ZRNU423NBAA
R32 Multi V™ Multi-Position Air Handling Unit
42,000 Btu/h Indoor Unit



Tag No.: _____

Date: _____

PO No.: _____

