

Job Name/Location:

Tag No.:

Date:

For:	File	Resubmit
	Approval	Other_____

PO No.:

Architect: _____ GC: _____

Engr: _____ Mech: _____

Rep: _____
(Company) (Project Manager)

LC249HHV
Single-Zone 3x3 Four-Way Ceiling Cassette with LGRED®
Outdoor Unit (ODU) - LUU240HHV, Indoor Unit (IDU) - LCN249HV



Performance:

Cooling:

Cooling Capacity (Min~Rated~Max, Btu/h)	9,600~24,000~30,000
SEER2	21.00
EER2	12.60

SEER - Seasonal Energy Efficiency Ratio EER - Energy Efficiency Ratio

Heating:

Heating Capacity (Min~Rated~Max, Btu/h)	10,800~27,000~33,000
HSPF2	10.20
Max. Heating @ Indoor 70°F DB (Btu/h)	
Outdoor 17°F WB	28,700
Outdoor 5°F WB	27,600
Outdoor -4°F WB	24,410
Outdoor -13°F WB	21,610

HSPF - Heating Seasonal Performance Factor Heating Nominal Test Conditions:
Cooling Nominal Test Conditions: Indoor: 70°F DB / 60°F WB
Indoor: 80°F DB / 67°F WB Outdoor: 47°F DB / 43°F WB
Outdoor: 95°F DB / 75°F WB

Electrical:

Power Supply (V/Hz/Ø)	208-230/60/1
MOP (A)	30
MCA (A)	22
Cooling / Heating Rated Amps (A)	8.5 / 8.5
Compressor (A)	14.5
Fan Motor (IDU + ODU) (A)	0.6 + 1.6
Cooling Power Input (Min~Rated~Max, kW)	0.48~1.91~3.00
Heating Power Input (Min~Rated~Max, kW)	0.57~2.25~3.80
Locked Rotor Amps (A)	23

MOP - Maximum Overcurrent Protection MCA - Minimum Circuit Ampacity

Piping:

Installed Liquid Pipe (in., O.D.)	3/8 Flare
Installed Vapor Pipe (in., O.D.)	5/8 Flare
IDU Liquid Connection (in., O.D.)	3/8 Flare
IDU Vapor Connection (in., O.D.)	5/8 Flare
Additional Refrigerant (oz./ft.)	0.43
Min. / Max. Pipe Length (ft.) ²	16.4 / 164
Piping Length (no add'l refrig., ft.)	24.9
Max. Elevation (ft.)	98.4

Features:

- Inverter (Variable Speed Compressor)
- Internal Condensate Pump
- Jet Cool / Jet Heat
- Auto Restart
- Auto Changeover
- Ultra-quiet Turbo Fan
- Night Quiet Function
- Optional Wi-Fi Control
- Drain Pan Heater
- Swirl Wind
- Direct / Indirect Wind
- Smart Mode
- Refresh Mode

Included Accessories:

- Wireless Remote Controller - AKB75735404

Required Accessories:

- Grille Kit - PT-AAGW0

Optional Accessories:

- Premium Panel (incl. Panel PT-AFGW0 + Air Purif. Kit PTAHMP0)-PT-AFGW0S
- Auto Elevation Kit-PTEGMO
- Decorative Cover-PTDCA
- Ventilation Kit + Flange³-PTVK410 + PTKV420
- Flange³-PTVK430
- MultiSITE™ CRC* Controller-PREMTBVC2/C3/C4
- Simple Remote Controller-PREMTB00U
- Standard III Remote Controller (White / Black)-PREMTB100 / PREMTBB10
- Remote Temperature Button Sensor-ZRTBS01
- Dry Contacts - PDRYCB100/320/400
- AC Smart 5 Central Controller-PACSSA000
- LonWorks® Gateway-ZHWLONWKO
- MultiSITE Comm. Mgr.-PBACNBTR0A
- PI-485-PMNFP14A1
- ACP 5 BACnet Gateway-PACPSA000
- AHU Comm. Kit-PAHCMR000
- Auxillary Heater Kit⁵-PRARH1
- Wi-Fi Module-PWFMD200
- Drain Pan Heater-PQSH1200
- Low Ambient Wind Baffle (Cooling operation to -4°F)-ZLABGP04A Requires 1

Operating Range:

Outdoor Unit:

Cooling (°F DB)	5 ~ 118
Heating (°F WB)	-13 ~ +64

Indoor Unit:

Cooling (°F WB)	57 ~ 77
Heating (°F DB)	59 ~ 81

System Data:

Refrigerant Type	R410A
Refrigerant Control	EEV
Refrigerant Charge (lbs.)	4.41
ODU Sound Pressure (Cooling / Heating) (±1 dB[A]) ³	51 / 52
IDU Sound Pressure (H/M/L/SL) (±1 dB[A]) ³	40 / 37 / 35 / 32
ODU Net / Shipping Weight (lbs.)	133.4 / 144.4
IDU Net / Shipping Weight (lbs.)	45.2 / 54.9
Grille Net Weight (lbs.)	15.6
Heat Exchanger Coating	GoldFin™

Fan:

ODU Type	Propeller
IDU Type	Turbo
Fan Speeds (Fan/Cool/Heat)	4 / 5 / 5
Quantity (ODU + IDU)	1 + 1
Motor/Drive	Brushless Digitally Controlled/Direct
Maximum ODU Air Volume (CFM)	2,048
IDU Air Flow (CFM Max./H/M/L)	794 / 671 / 600 / 530
Dehumidification (pts./hr.)	3.80

Notes:

1. Acceptable operating voltage: 187V-253V.
 2. Piping lengths are equivalent.
 3. Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.
 4. All communication / connection (power) cable from the outdoor unit to the indoor unit is field supplied and must be a minimum of four-conductor, 14 AWG, stranded, shielded or unshielded (if shielded, it must be grounded to the chassis of the outdoor unit only), and must comply with applicable local and national codes.
 5. See Engineering Manual for sensible and latent capacities.
 6. Power wiring cable size must comply with the applicable local and national code.
 7. This unit comes with a dry helium charge.
 8. This data is rated 0 ft. above sea level, with 24.6 ft. of refrigerant line and a 0 ft. level difference between outdoor and indoor units.
 9. Must follow installation instructions in the applicable LG installation manual.
 10. If the optional low ambient wind baffle (ZLABGP04A) is used, one wind baffle is required for each ODU fan.
- BACnet® is a registered trademark of ASHRAE. LonWorks® is a trademark of Echelon Corporation.



162279



For a complete list of available accessories, contact your LG representative.
For continual product development, LG reserves the right to change specifications without notice.
© LG Electronics U.S.A., Inc., Englewood Cliffs, NJ. All rights reserved. "LG Life's Good" is a registered trademark of LG Corp. /www.lghvac.com



LC249HHV
 Single-Zone 3x3 Four-Way Ceiling Cassette with LGRED®
 Outdoor Unit (ODU) - LUU240HHV, Indoor Unit (IDU) - LCN249HV



Tag No.: _____
 Date: _____
 PO No.: _____

Symbols
 → Piping Direction
 ⊣ Datum line

Unit: inch

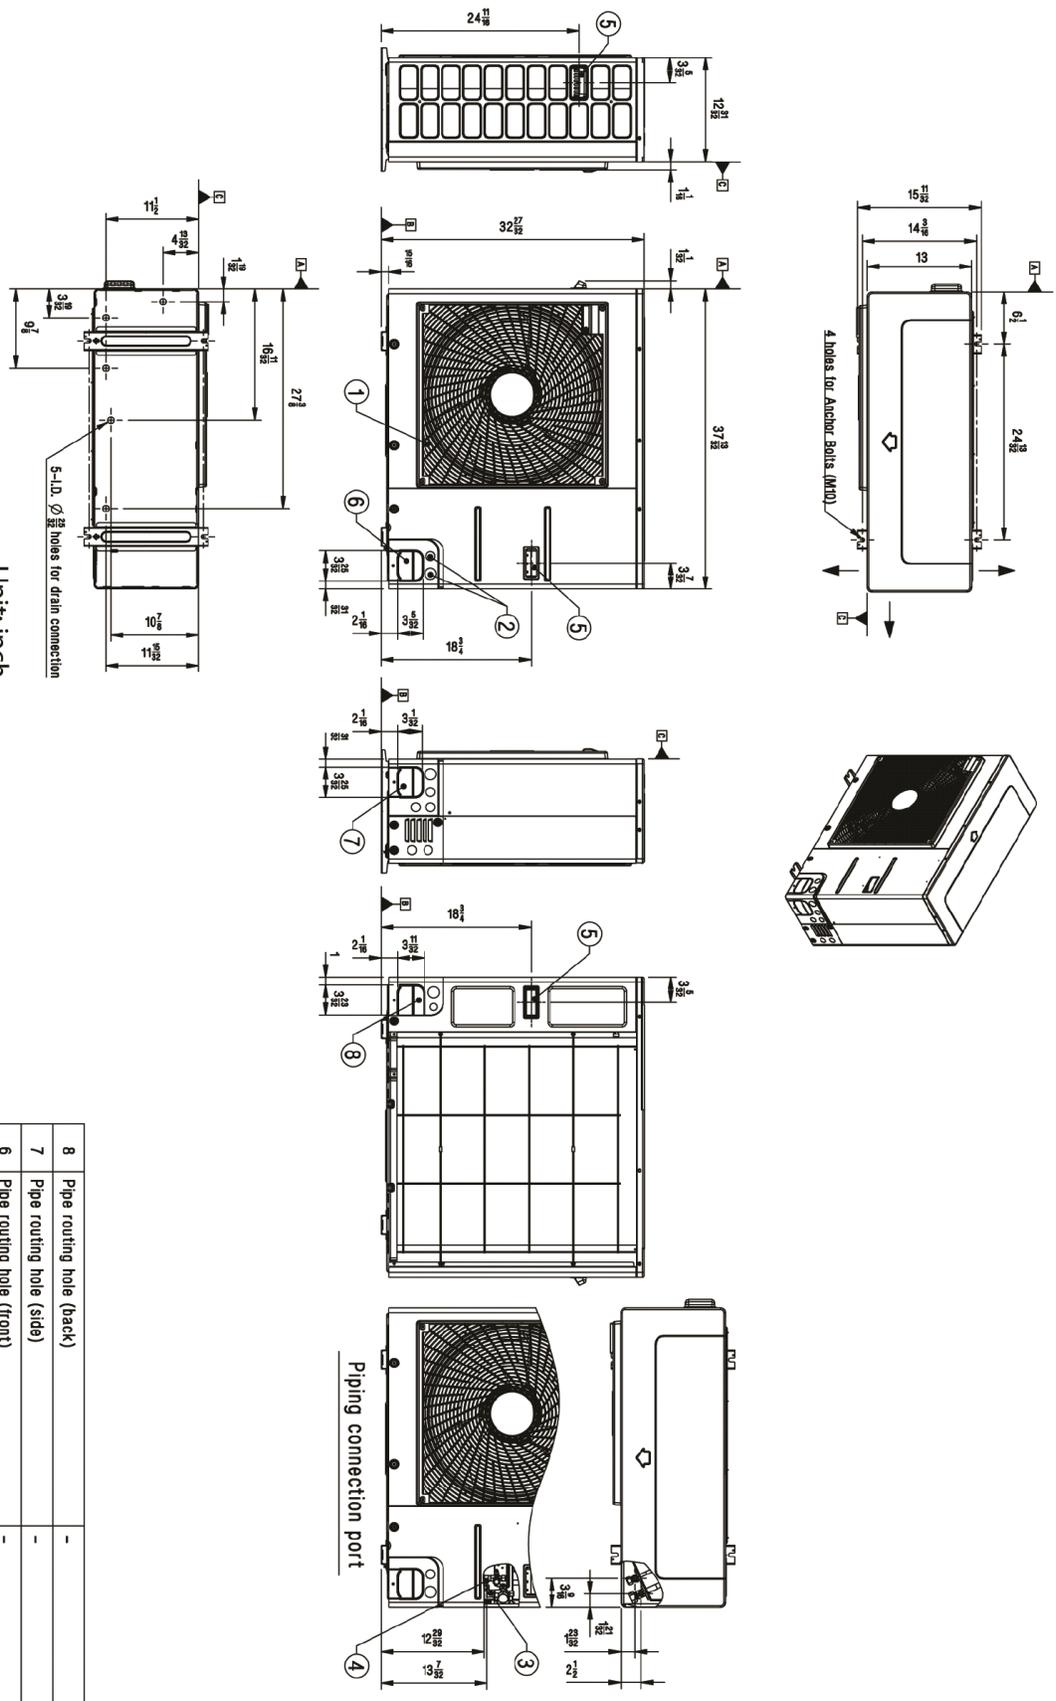

No.	Part Name	Description
1	Air Outlet	-
2	Power and communication cable Hole	-
3	Gas Pipe Connection	Flare joint
4	Liquid Pipe Connection	Flare joint
5	Handle	-
6	Pipe routing hole (front)	-
7	Pipe routing hole (side)	-
8	Pipe routing hole (back)	-

LC249HHV

Single-Zone 3x3 Four-Way Ceiling Cassette with LGRED®

Outdoor Unit (ODU) - LUU240HHV, Indoor Unit (IDU) - LCN249HV





Tag No.: _____



Date: _____

PO No.: _____


[Unit: inch]

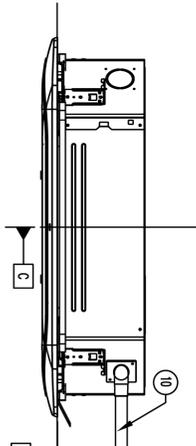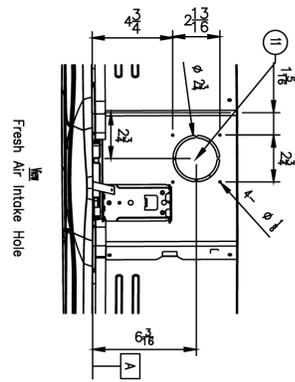




Head of Water lift : 31 1/2" or less

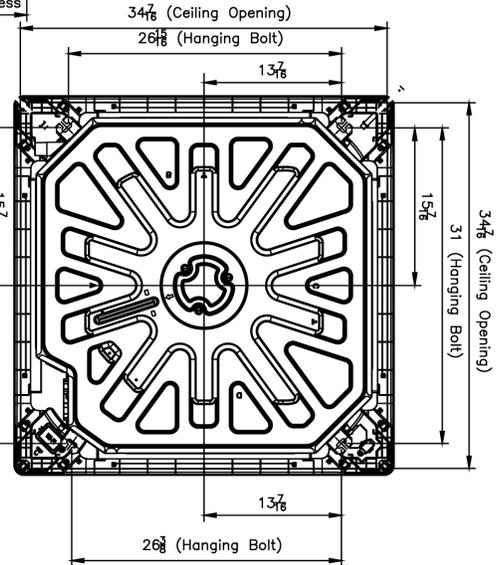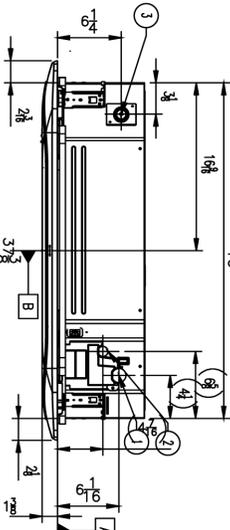

Symbols



- Note:**
1. Unit should be installed in compliance with the installation manual.
 2. Unit should be grounded in accordance with the local regulations or applicable national codes.
 3. All electrical components and materials to be supplied from the site must comply with the local regulations or international codes.

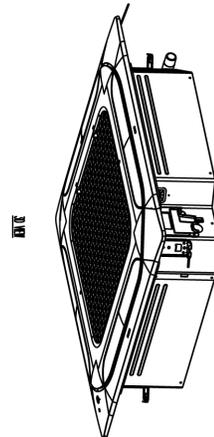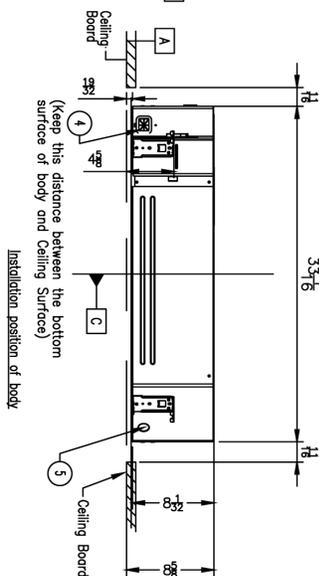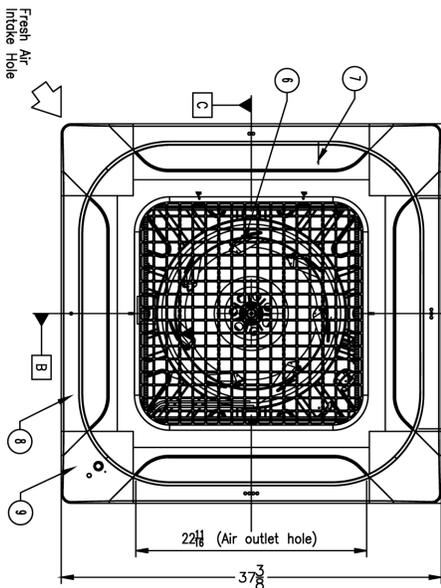

No.	Part Name	Description
1	Gas Pipe Connection	-
2	Liquid Pipe Connection	-
3	Drain Pipe Connection	-
4	Power and communication cable routing hole	-
5	Wired remote controller wire routing hole	-
6	Air Inlet	-
7	Air Outlet	-
8	Decorion Panel (Accessory)	PF*-WA**W
9	Decorion Corner Cover	Supplied with panel
10	Flexible Drain Hose	Supplied with product
11	Fresh Air Intake Hole	Knock-out type