Job Name/Location: Tag #: For: File Resubmit Date: **LG Approval** Other\_ PO No.: GC: Architect: Mech: Engr: Rep: (Project Manager) LV480HV1 Single Zone Vertical Air Handling Unit Outdoor Unit (ODU) - LUU480HV Indoor Unit (IDU) - LVN480HV Performance: **Operating Range:** Cooling: **Outdoor Unit:** 18.000 ~ 48.000 ~ 53.000 Cooling Capacity (Min~Rated~Max, Btu/h) Cooling (°F DB) 5 to 118 16.50/9.70 SEER2 / EER2 Heating (°F WB) -4 to 64 SEER - Seasonal Energy Efficiency Ratio EER - Energy Efficiency Ratio Indoor Unit: **Heating:** Cooling (°F WB) 57 to 77 Heating Capacity (Min~Rated~Max, Btu/h) 19,000 ~ 50,000 ~ 60,000 59 to 81 Heating (°F DB) HSPF2 9.30 System Data: Max heating @ Indoor 70° DB (Btu/h) 40,000 **R410A / EEV** Refrigerant Type/Control Outdoor 17°F WB 39,500 Outdoor 5°F WB Refrigerant Charge (lbs.) 7.5 Outdoor -4°F WB 33,020 ODU Sound Pressure Max (Cool / Heat) ±1 dB(A)3 52/54 HSPF - Heating Seasonal Performance Factor Cooling Nominal Test Conditions: IDU Sound Pressure (H/M/L) ±1 dB(A)3 49 / 48 / 44 Heating Nominal Test Conditions: ODU Net / Shipping Weight (lbs.) 193.1 / 217.4 Indoor: 80°F DB / 67°F WB Indoor: 70°F DB / 60°F WB Outdoor: 95°F DB / 75°F WB Outdoor: 47°F DB / 43°F WB IDU Net / Shipping Weight (lbs.) 158.7 / 176.4 **Electrical:** 208-230 / 60 / 1 Power Supply<sup>1</sup> (V/Hz/Ø) Propeller/Sirocco ODU / IDU Fan Type MOP / MCA (A) 40 / 32 3/3/3 Fan Speeds (Fan/Cool/Heat) 24.2 / 24.2 Cooling / Heating Rated Amps (A) Fan Quantity (ODU + IDU) 22.0 Compressor(A) Motor/Drive Brushless Digitally Controlled / Direct Fan Motor (IDU + ODU) (A)  $2.2 + (1.6 \times 2)$ Maximum ODU Air Volume (CFM) 1,942 x 2 Cooling Power Input (Min~Rated~Max, kW) 1.40 ~ 4.95 ~ 6.00 Heating Power Input (Min~Rated~Max, kW) 1.50 ~ 4.19 ~ 6.20 IDU Air Volume (H/M/L) (CFM) 1,400 / 1,260 / 1,000 Dehumidification Rate (pts/hr)10 MOP - Maximum Overcurrent Protection MCA - Minimum Circuit Ampacity 11.0 IDU External Static Pressure Operating Piping: 0.1~ 0.3 ~ 1.0 Range (Min~Default~Max) (in-wg)11 Installed Liquid Pipe (in., O.D.) 3/8 Flare 5/8 Flare Installed Vapor Pipe (in., O.D.) NOTES:

1. Acceptable operating voltage: 187V-253V.
2. Piping lengths are equivalent.
3. Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.
4. All power/communication cable to be minimum 14 American wire gage (AWG),
4-conductor, stranded, shielded or unshielded wire and must comply with applicable local and national code. If shielded, the wire must be grounded to the chassis at the outdoor unit only.
5. Power wiring cable size must comply with the applicable local and national code.
6. The indoor unit comes with a dry helium charge.
7. This data is rated 0 ft. above sea level, with 25 ft. of refrigerant line and a 0 ft. level difference between outdoor and indoor units.
8. Must follow installation instructions in the applicable LG installation manual. 3/8 Flare IDU Liquid Connection (in., O.D.) IDU Vapor Connection (in., O.D.) 5/8 Flare Additional Refrigerant (oz./ft.) 0.43 16.4 / 246 Min/Max. Pipe Length (ft.) 24.6 Piping Length (no add'l refrig., ft.) 98.4 Max. Elevation (ft.) 8. Must follow installation instructions in the applicable LG installation manual.

9. If the optional low ambient wind baffle (ZLABGP04A) is used, one wind baffle is required for each ODU fan.

10. Dehumidification rate is based on high speed airflow. Features: Group control Built in dry contact 11. Electric heater accessory available in 3kW, 5kW, 8kW, 10kW, 15kW, and 20kW Hot start
 Inverter (variable speed)
 Auto restart
 Timer (on/off)
 Sleep Mode ESP (External Static Pressure) Control capacities. Refer to the engineering manual for details. Control lock Optional Wi-Fi Control 12. Controller not included. Required Accessories (sold separately): Controller (Any LG wired remote controller) Optional Accessories: ☐ MultiSITE™ CRC2 - PREMTBVC2 ☐ Drain Pan Heater - PQSH1200 ☐ MultiSITE™ CRC2+-PREMTBVC3 ☐ MultiSITE™ CRC2+Z-PREMTBVC4 ☐ Dry Contact - PDRYCB320 Low Ambient Wind Baffle (cooling







Proper sizing and installation of equipment is critical to achieve optimal performance. Split system air conditioners and heat pumps (excluding ductless systems) must be matched with appropriate coil components to meet ENERGY STAR® criteria. Ask your contractor for details or visit www.energystar.gov. (ENERGY STAR and the ENERGY STAR mark are registered trademarks owned by the U.S. Environmental Protection Agency.)



☐ MultiSITE™ Comm. Mgr. - PBACNBTR0A

Remote Temperature Sensor - ZRTBS01 Aux Heater Relay Kit - PRARH1

AC Smart 5 - PACS5A000

Simple Controller - PREMTC00U
Wi-Fi module - PWFMDD200

☐ ACP 5 - PACP5A000

operation to -4°F) - ZLABGP04A<sup>9</sup>


☐ Electric Heater 3kW - ANEH033B1<sup>11</sup>


☐ PI-485 Control Board - PMNFP14A1

■ Downflow Conversion Kit - PNDFK0

Job Name/Loc	cation:
--------------	---------

## LVN480HV Single Zone Vertical Air Handling Unit




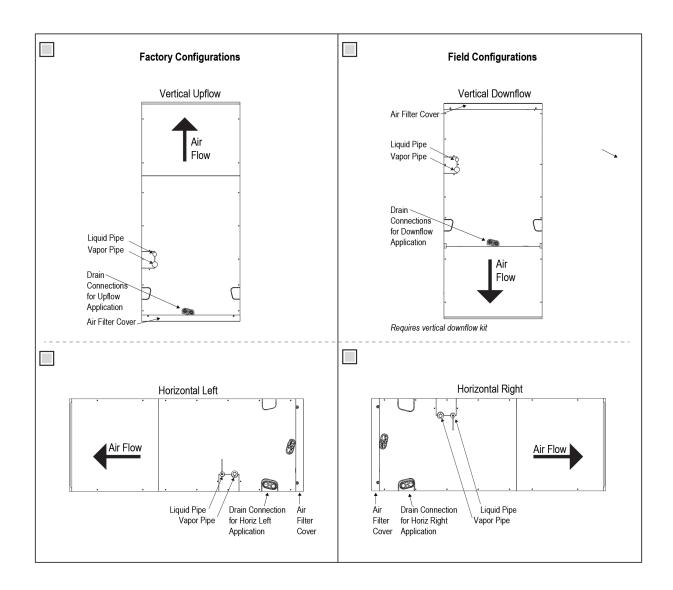


Job Name/Location:


## LUU480HV

Single Zone Vertical Air Handling Unit



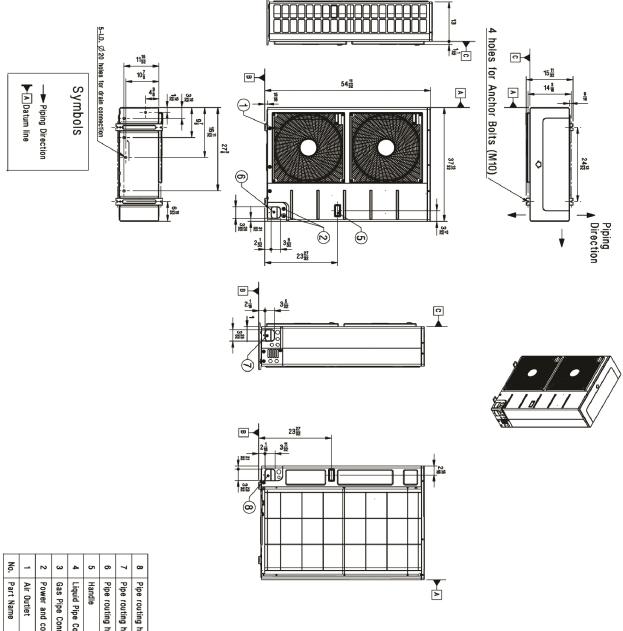

Part Name	Air Outlet	Power and communication cable Hole	Gas Pipe Connection	Liquid Pipe Connection	Handle	Pipe routing hole (front)	Pipe routing hole (side)	Pipe routing hole (back)
Description	-	-	Flare joint	Flare joint	-	-	-	•



Job Name/Location:

## LVN480HV Single Zone Vertical Air Handling Unit







