

Job Name/Location:

Tag No.:

Date:


For:	File	Resubmit
	Approval	Other_____

PO No.:

Architect: _____ GC: _____

Engr: _____ Mech: _____

Rep: _____
(Company) (Project Manager)



KSUJA301A
Single Zone Mid Static Ducted LGRED°
Outdoor Unit (ODU) - KUSXA301A, Indoor Unit (IDU) - KNUJB301A



Performance:

Cooling:

Cooling Capacity (Min~Rated~Max, Btu/h)	12,000 ~ 30,000 ~ 36,000
SEER2	18.80
EER2	13.50

SEER - Seasonal Energy Efficiency Ratio EER - Energy Efficiency Ratio

Heating:

Heating Capacity (Min~Rated~Max, Btu/h)	14,000 ~ 34,000 ~ 40,000
HSPF2	9.5
Max. Heating @ Indoor 70°F DB (Btu/h)	
Outdoor 17°F WB	36,000
Outdoor 5°F WB	34,000
Outdoor -4°F WB	29,500
Outdoor -13°F WB	28,250

HSPF - Heating Seasonal Performance Factor Heating Nominal Test Conditions:
Cooling Nominal Test Conditions: Indoor: 70°F DB / 60°F WB
Indoor: 80°F DB / 67°F WB Outdoor: 47°F DB / 43°F WB
Outdoor: 95°F DB / 75°F WB

Electrical:

Power Supply (V/Hz/Ø)	208-230/60/1
MOP (A)	35
MCA (A)	32
Cooling / Heating Rated Amps (A)	27.5
Compressor (A)	22
Fan Motor (IDU + ODU) (A)	2.3 + (1.6 x 2)
Cooling Power Input (Min~Rated~Max, kW)	0.56 ~ 2.22 ~ 3.50
Heating Power Input (Min~Rated~Max, kW)	0.64 ~ 2.65 ~ 4.08
Locked Rotor Amps (A)	22

MOP - Maximum Overcurrent Protection MCA - Minimum Circuit Ampacity

Piping:

Installed Liquid Pipe (in., O.D.)	3/8
Installed Vapor Pipe (in., O.D.)	5/8
IDU Liquid Connection (in., O.D.)	3/8
IDU Vapor Connection (in., O.D.)	5/8
Additional Refrigerant (oz./ft.)	0.43
Min. / Max. Pipe Length (ft.) ²	16.4 / 164
Piping Length (no add'l refriger., ft.)	24.6
Max. Elevation (ft.)	98.4

Features:

- Inverter (Variable Speed Compressor)
- Internal Condensate Pump
- Jet Cool / Jet Heat
- Auto Restart
- R32 Leak Detection Sensor
- Auto Changeover
- Night Quiet Operation
- Optional Wi-Fi Control
- Drain Pan Heater
- Direct / Indirect Wind
- Swirl Wind
- Smart Mode
- Refresh Mode
- Optional Aux Heater Relay Kit

Optional Accessories:

- Auxiliary Heater Kit - PRARH1
- Vertical Installation Kit - ABDAMA0
- Wi-Fi Module - PWFMD200
- Single Port Shutoff Valve - PRHPZ010A
- ODU Wind Baffle - ZLABGP04B (x2)

Controller Options:

- MultiSITE™ CRC Controllers
- Simple Remote Controller
- Standard III Remote Controllers
- Remote Temperature Button Sensor
- Dry Contacts
- AC Smart 5 Central Controller
- LonWorks® Gateway
- MultiSITE Comm. Mgr.
- ACP 5 BACnet™ Gateway

For a complete list of available accessories, contact your LG representative.

For continual product development, LG reserves the right to change specifications without notice.

© LG Electronics U.S.A., Inc., Englewood Cliffs, NJ. All rights reserved. "LG Life's Good" is a registered trademark of LG Corp. /www.lghvac.com

Operating Range:

Outdoor Unit:

Cooling (°F DB)	5 ~ 118
Heating (°F WB)	-13 ~ +64

Indoor Unit:

Cooling (°F WB)	57 ~ 77
Heating (°F DB)	59 ~ 81

System Data:

Refrigerant Type	R32
Refrigerant Control	EEV
Refrigerant Charge (lbs.)	6.6
ODU Sound Pressure (Cooling / Heating) (±1 dB[A]) ³	52 / 54
IDU Sound Pressure (H/M/L) (±1 dB[A]) ³	34 / 33 / 32
ODU Net / Shipping Weight (lbs.)	190.2 / 214.3
IDU Net / Shipping Weight (lbs.)	85.3 / 98.3
Heat Exchanger Coating	GoldFin™

Fan:

ODU Type	Propeller
IDU Type	Sirocco
Fan Speeds (Fan/Cool/Heat)	3 / 3 / 3
Quantity (ODU + IDU)	2 + 1
Motor/Drive	Brushless Digitally Controlled/Direct
Maximum ODU Air Volume (CFM)	1,942 x 2
IDU Air Flow (CFM Max. H/M/L)	989 / 848 / 741
Default ESP (in wg)	0.24
Minimum ESP/Fan Setting Value ⁴	0.1 / 84
Maximum ESP/Fan Setting Value ⁴	0.59 / 124
Dehumidification (pts./hr.)	5.6

Notes:

1. Acceptable operating voltage: 187V-253V.
2. Piping lengths are equivalent.
3. Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.
4. Maximum static pressure may result in reduced airflow (CFM).
5. All power supply wiring to the outdoor unit is field supplied, solid or stranded. The power wiring and the communication wiring from the outdoor unit to the indoor unit is field supplied and must be stranded, shielded or unshielded (if shielded, it must be grounded to the chassis of the outdoor unit only). All wiring must comply with applicable local and national codes.
 - a. Power Supply Wiring to IDU: (No. x AWG): 3 x 12 for 9k, 12k, 18k, and 24k; 3 x 10 for 30k, 36k, 42k, and 48k.
 - b. Power Wiring and Communication Wiring from Outdoor Unit to Indoor Unit: (No. x AWG) 3 x 14 / 2 x 18.
6. See Engineering Manual for sensible and latent capacities.
7. Power wiring cable size must comply with the applicable local and national code.
8. The indoor unit comes with a dry helium charge.
9. This data is rated 0 ft. above sea level, with 24.6 ft. of refrigerant line and a 0 ft. level difference between outdoor and indoor units.
10. Must follow installation instructions in the applicable LG installation manual.
11. If the optional low ambient wind baffle is used, one wind baffle is required for each ODU fan.

BACnet® is a registered trademark of ASHRAE. LonWorks® is a trademark of Echelon Corporation.



Proper sizing and installation of equipment is critical to achieve optimal performance. Split system air conditioners and heat pumps (excluding ductless systems) must be matched with appropriate coil components to meet ENERGY STAR® criteria. Ask your contractor for details or visit www.energystar.gov. (ENERGY STAR and the ENERGY STAR mark are registered trademarks owned by the U.S. Environmental Protection Agency.)

SB_SZ_MidStatic_Ducted_LGRED_R32_KSUJA301A_2026_03_10_170155

KSUJA301A

Single Zone Mid Static Ducted LGRED°


Outdoor Unit (ODU) - KUSXA301A, Indoor Unit (IDU) - KNUJB301A



Tag No.: _____

Date: _____

PO No.: _____

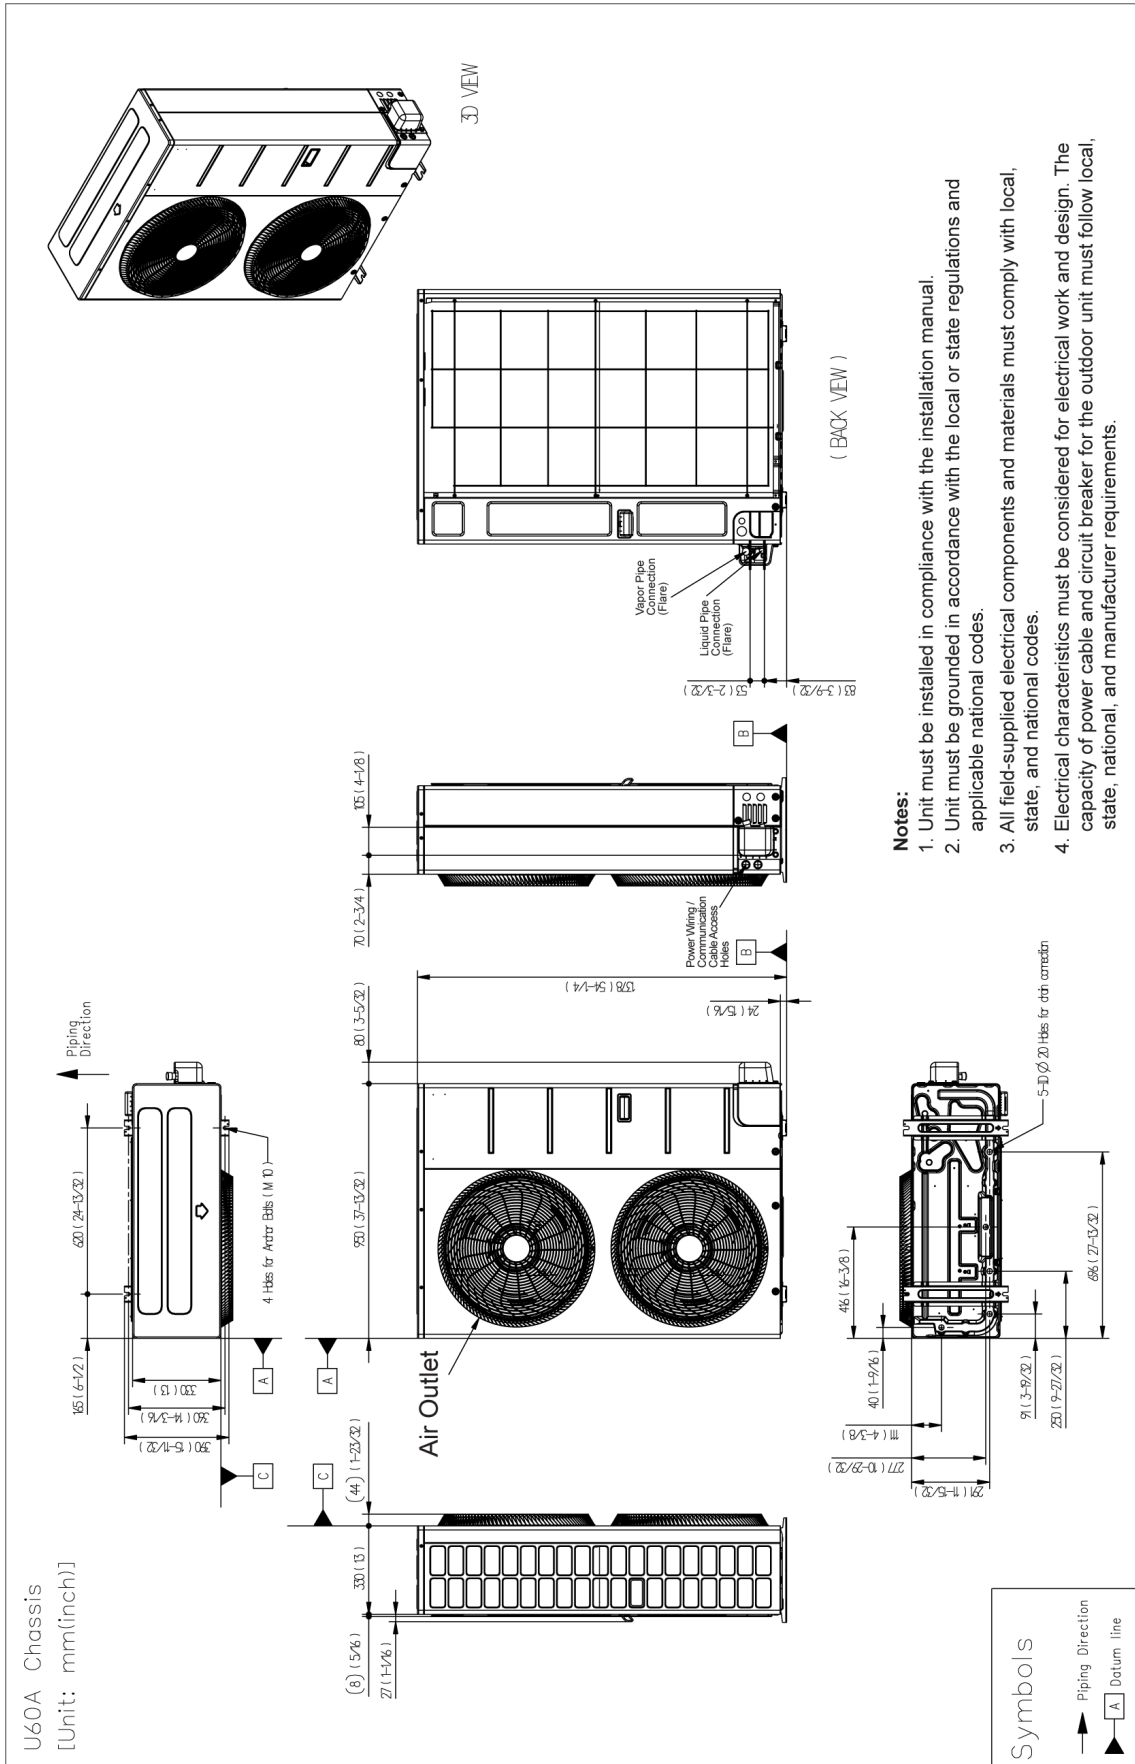

Notes:

1. Unit must be installed in compliance with the installation manual.
2. Unit must be grounded in accordance with the local or state regulations and applicable national codes.
3. All field-supplied electrical components and materials must comply with local, state, and national codes.
4. Electrical characteristics must be considered for electrical work and design. The capacity of power cable and circuit breaker for the outdoor unit must follow local, state, national, and manufacturer requirements.

KSUJA301A

Single Zone Mid Static Ducted LGRED°


Outdoor Unit (ODU) - KUSXA301A, Indoor Unit (IDU) - KNUJB301A



Tag No.: _____

Date: _____

PO No.: _____

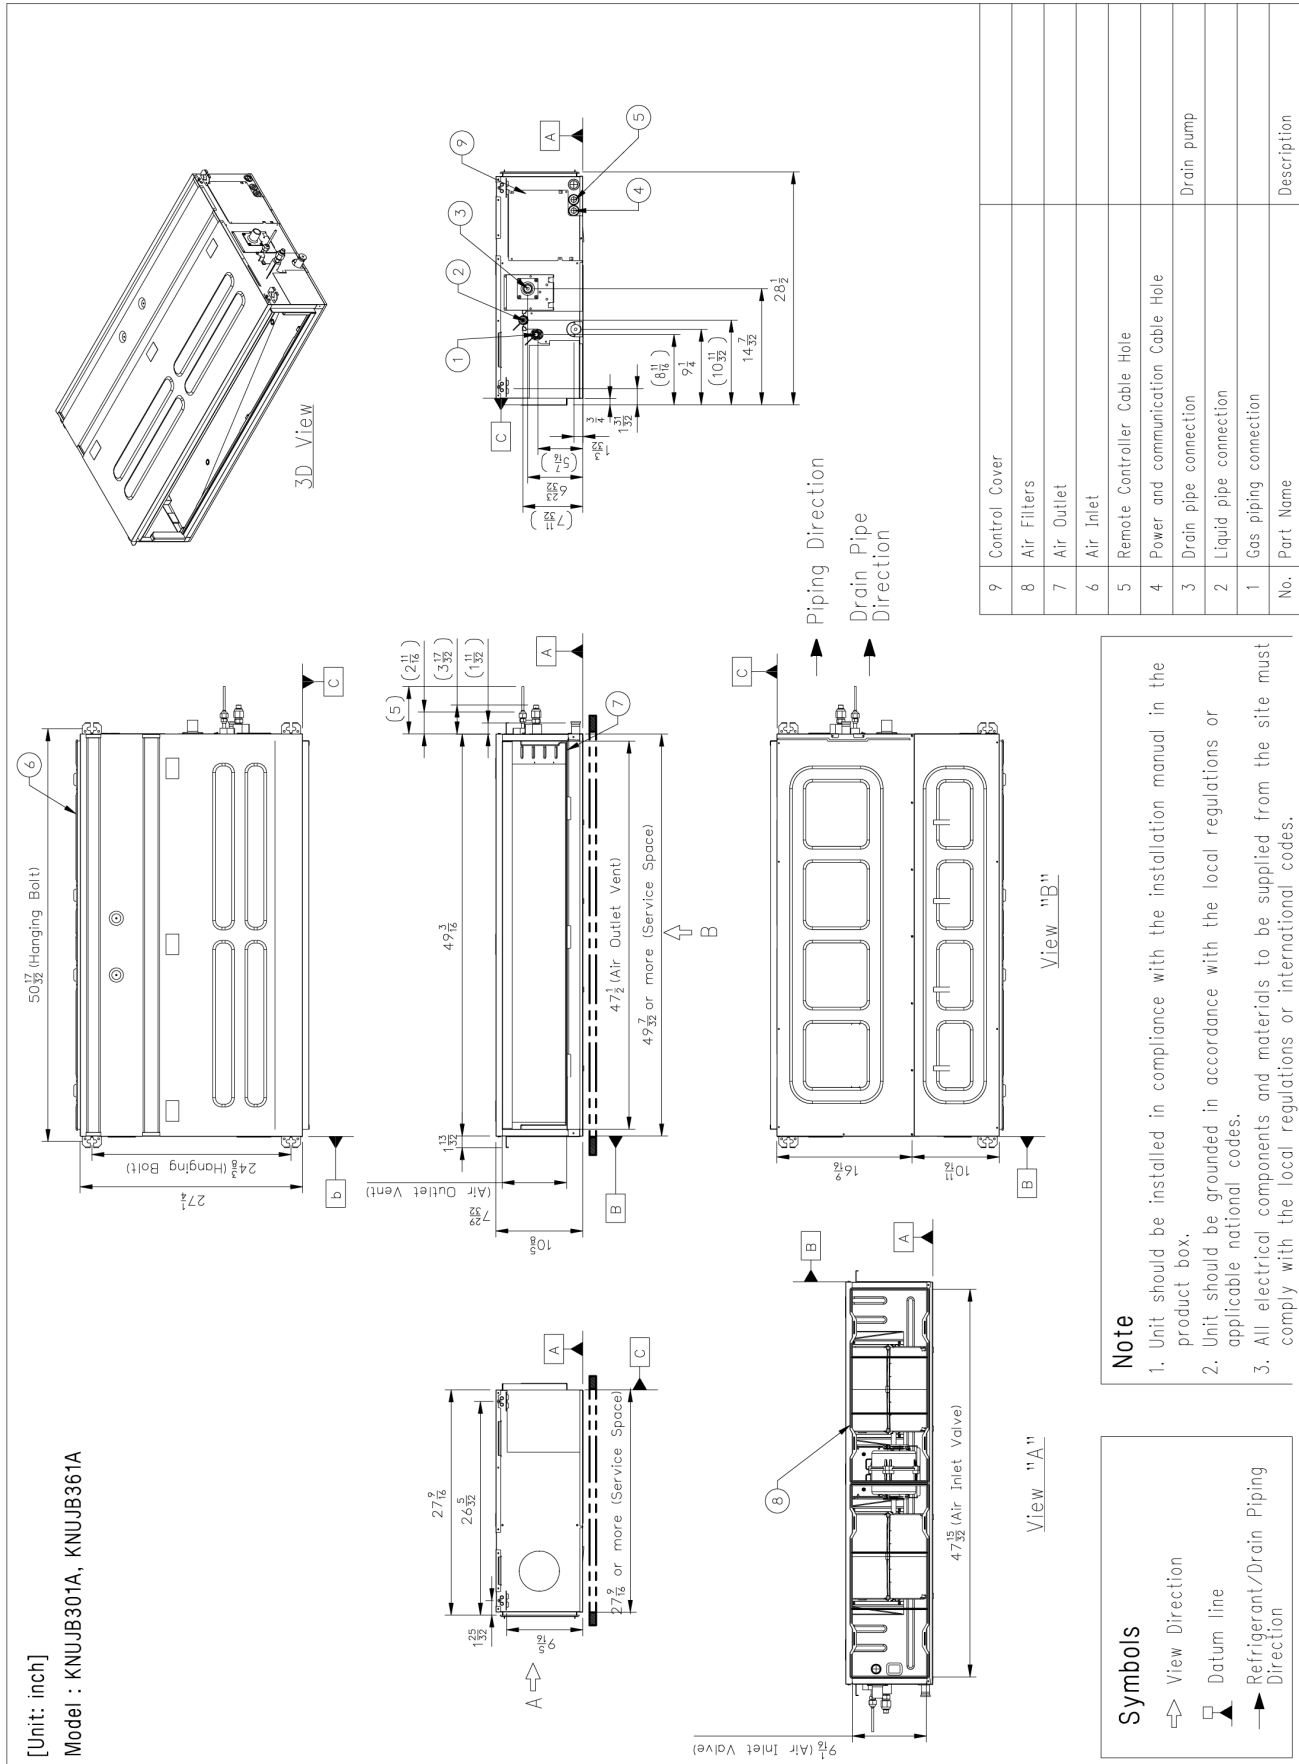

[Unit: inch]

Model : KNUJB301A, KNUJB361A

Note

- Unit should be installed in compliance with the installation manual in the product box.
- Unit should be grounded in accordance with the local regulations or applicable national codes.
- All electrical components and materials to be supplied from the site must comply with the local regulations or international codes.

Symbols

- View Direction
- Datum line
- Refrigerant/Drain Piping Direction

No.	Part Name	Description
9	Control Cover	
8	Air Filters	
7	Air Outlet	
6	Air Inlet	
5	Remote Controller Cable Hole	
4	Power and communication Cable Hole	
3	Drain pipe connection	Drain pump
2	Liquid pipe connection	
1	Gas piping connection	