For: File Resubmit Date: Approval Other\_ PO No .: GC: Architect: Mech: Engr: Rep: (Project Manager)

Tag No.:





# LS363HLV3

Job Name/Location:

Single Zone Extended Piping Wall Mount Outdoor Unit (ODU) - LSU363HLV3, Indoor Unit (IDU) - LSN363HLV3

#### Performance:

## Cooling:

Cooling Capacity	
(Min~Rated~Max) (Btu/h)	3,070~33,000~34,000
SEER2	19
EER2	10

SEER - Seasonal Energy Efficiency Ratio EER - Energy Efficiency Ratio

Heating:

Heating Capacity	
(Min~Rated~Max) (Btu/h)	3,070~35,200~38,900
HSPF2	7.9
Max. Heating @ Indoor 70°F DB	
Outdoor 19°F DB / 17°F WB	35,740 (102%)
Outdoor 6°F DB / 5°F WB	30,890 (88%)
Outdoor -3°F DB / -4°F WB	26,820 (76%)

HSPF - Heating Seasonal Performance Factor Cooling Nominal Test Conditions: Indoor: 80°F DB / 67°F WB

Indoor: 70°F DB / 60°F WB Outdoor: 47°F DB / 43°F WB

## Outdoor: 95°F DB / 75°F WB **Outdoor Unit:**

MOP (A)	30
MCA (A)	23
Cooling / Heating Rated Amps (A)	15.35
Compressor (A)	15.1
Fan Motor (A)	0.25

MOP - Maximum Overcurrent Protection MCA - Minimum Circuit Ampacity

## **Total Power Input:**

Cooling Power Input (kW)	3.3
Heating Power Input (kW)	3.12

## Piping:

Liquid Line (in., O.D.)	ø3/8 Flare
Vapor Line (in., O.D.)	ø5/8 Flare
Additional Refrigerant (oz./ft.)	0.38
Min. / Max. Pipe Length (ft.) <sup>2</sup>	9.8 / 164
Piping Length (no add'l refrig., ft.)	24.6
Max. Elevation (ft.)	98.4

## Features:

- 24-Hour on/off timer
- 4-Way auto swing Auto changeover
- Auto restart
- Jet cool/Jet heat
- Built-in low ambient standard, down to 14°F (cooling mode)
- Optional Accessories:
- ☐ Low Ambient Wind Baffle (Cooling operation to 0°F) - ZLABGP04A ☐ Simple Remote Controller - PREMTC00U ☐ Dry Contact - PDRYCB100/320/400 ☐ Std III Remote Controller (White / Black)-PREMTB100 / PREMTBB10 ☐ MultiSITE™ CRC\* - PREMTBVC2/C3/C4
- Condensate Sensor Connection
- Inverter (variable speed compressor)
- Smart Diagnosis
- Washable Filter
- Self-cleaning indoor coil
- Built-in base pan heater
- Built-in Wi-Fi via Smart ThinQ app
- ☐ MultiSITE Comm. Mgr. PBACNBTR0A ☐ PI-485 - PMNFP14A1
  - ☐ AC Smart 5 PACS5A000 ☐ ACP 5 BACnet Gateway-PACP5A000
  - ☐ LonWorks® Gateway-ZHWLONWK0

## **Operating Range:**

**Outdoor Unit:** 

Cooling (°F DB)	14 ~ 118
Heating (°F WB)	-4 ~ +65
Indoor Unit:	
Cooling (°F WB)	53 ~ 75
Heating (°F DB)	64 ~ 86

#### **Electrical:**

ı	Power Supply (V <sup>1</sup> /Hz/Ø)	208-230/60/1

### **System Data:**

Refrigerant Type	R410A
Refrigerant Control	EEV
Refrigerant Charge (lbs.)	5.291
ODU Sound Pressure	
(Cooling / Heating) (±1 dB[A]) <sup>3</sup>	55 / 58
IDU Sound Pressure	
Cooling (H/M/L/Sleep) (±1 dB[A]) <sup>3</sup>	51 / 47 / 43 / 33
Heating (H/M/L) (±1 dB[A]) <sup>3</sup>	51 / 47 / 43
ODU Net / Shipping Weight (lbs.)	147.9 / 160.3
IDU Net / Shipping Weight (lbs.)	40.8 / 48.9
Heat Exchanger Coating	GoldFin™

## Fan:

ODU Type	Propeller
IDU Type	Cross Flow
Fan Speeds (Fan/Cool/Heat)	6/6/6
Quantity (ODU + IDU)	1+1
Motor/Drive	Brushless Digitally Controlled/Direct
ODU Max. Air Flow Rate (CFM)	2,295
IDU Air Flow	,
Cooling, Max/H/M/L (CFM)	1,095 / 883 / 742 / 601
Heating, Max/H/M/L (CFM)	1,166 / 954 / 813 / 671
Dehumidification (pts./hr.)	5.49

## Notes:

- Acceptable operating voltage: 187V-253V.
- 2. Piping lengths are equivalent.
- Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.
   All communication / connection (power) cable from the outdoor unit to the indoor unit is field supplied and must be a minimum of four-conductor, 14 AWG, stranded, shielded or unshielded (if shielded, it must be and must be a minimum of four-conductor, 14 AWG, stranded, shielded or unshielded (if shielded, it must be grounded to the chassis of the outdoor unit only), and must comply with applicable local and national codes.

  5. See Engineering Manual for sensible and latent capacities.

  6. Power wiring cable size must comply with the applicable local and national code.

  7. The indoor unit comes with a dry helium charge.

  8. This data is rated 0 ft. above sea level, with 24.6 ft. of refrigerant line and a 0 ft. level difference between

- outdoor and indoor units.

  9. Must follow installation instructions in the applicable LG installation manual









# LS363HLV3

Single Zone Extended Piping Wall Mount
Outdoor Unit (ODU) - LSU363HLV3, Indoor Unit (IDU) - LSN363HLV3



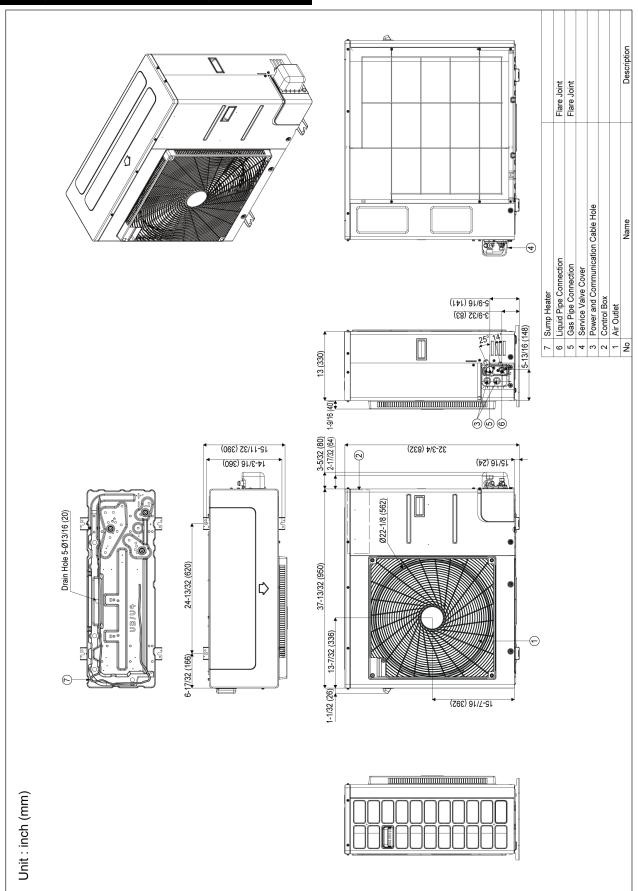

# LS363HLV3

Single Zone Extended Piping Wall Mount Outdoor Unit (ODU) - LSU363HLV3, Indoor Unit (IDU) - LSN363HLV3



Tag No.:

Date:

PO No.:

